


W	D
WATER MAIN	48" MIN.
WHC	42" MIN.

TYPICAL SECTION
(SEPARATE TRENCH)

L	H
10'-0" & GREATER	N/A
LESS THAN 10'-0"	1'-6" MIN.

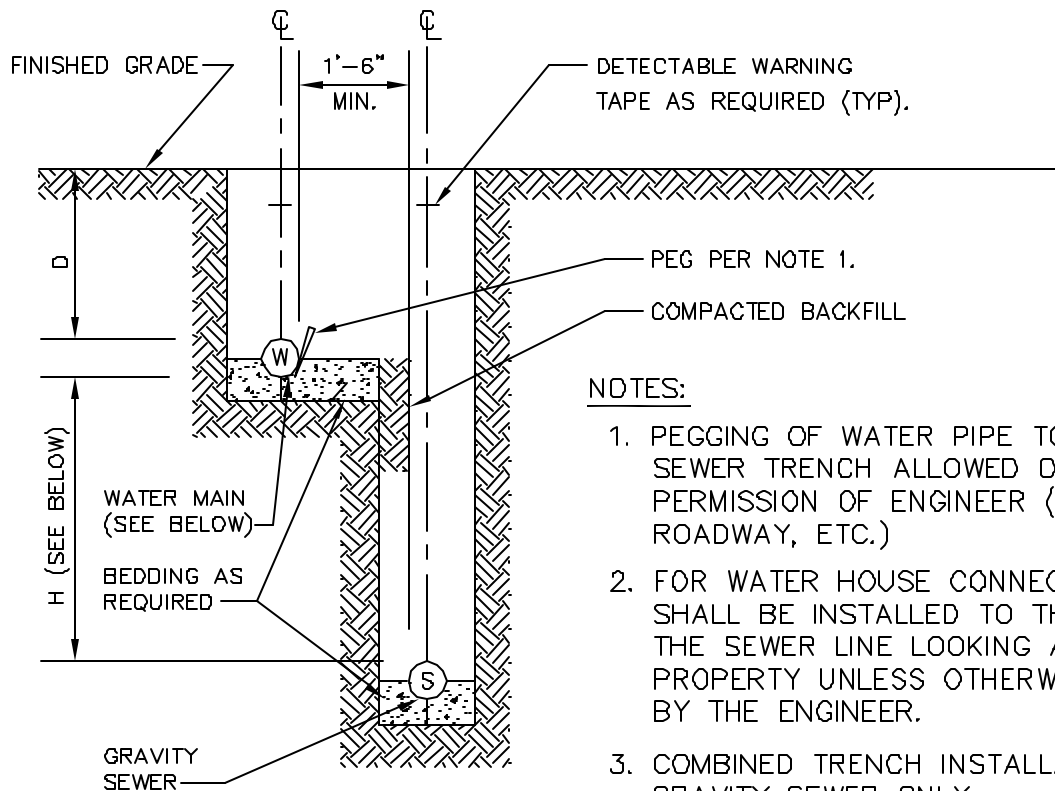

NOTES:

1. PEGGING OF WATER PIPE TO SIDE OF SEWER TRENCH ALLOWED ONLY WITH PERMISSION OF ENGINEER (PAVED ROADWAY, ETC.)
2. FOR WATER HOUSE CONNECTION, WATER SHALL BE INSTALLED TO THE LEFT OF THE SEWER LINE LOOKING AT THE PROPERTY UNLESS OTHERWISE DIRECTED BY THE ENGINEER.
3. COMBINED TRENCH INSTALLATION FOR GRAVITY SEWER ONLY.

W	H
DUCTILE IRON	1'-6" (MIN.)
COPPER	1'-0" (MIN.)

OPTIONAL SECTION
(COMBINED TRENCH)

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: SEP 12 2002

Paul R. Huggins
Chief Engineer

STANDARD DETAIL

MINIMUM CLEARANCE
OF WATER PARALLEL
TO SEWER.

M
18.0