


CONNECT ANODE TO RESTRAIN
JOINT WITH BOLTED CONNECTION,
SEE DETAIL C/1.2

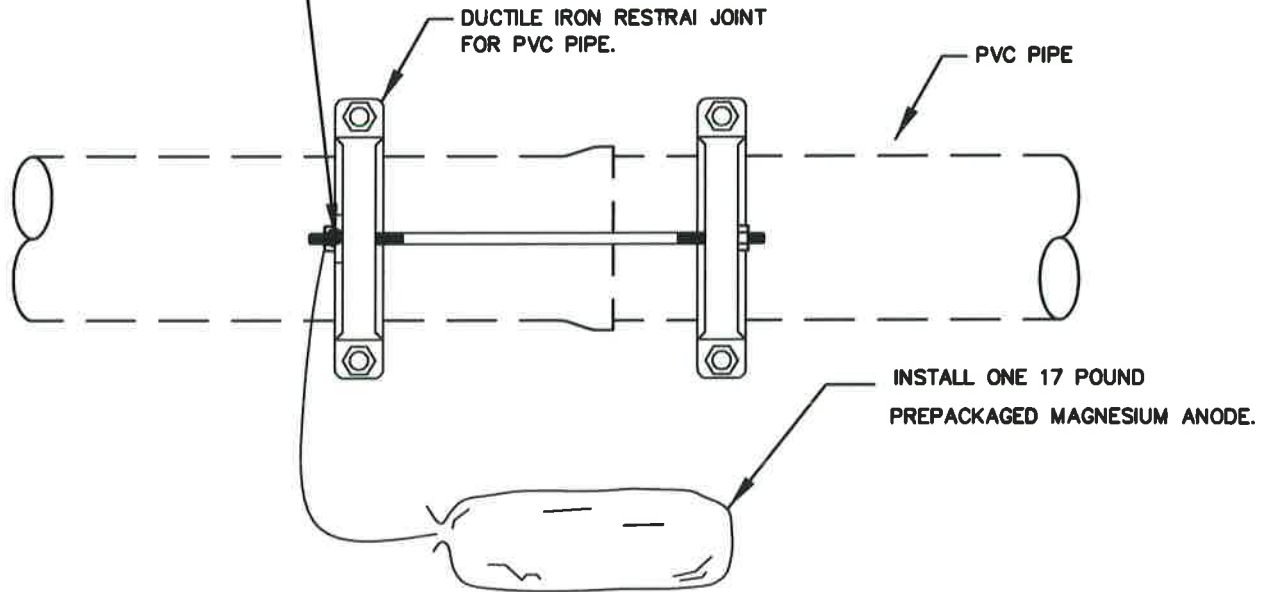

NOTES:

1. ANODES PLACED AT SAME DEPTH AS THE BOTTOM OF PIPE AND AT A MINIMUM OF 12" FROM EDGE OF PIPE, SEE DETAIL C/7.12.
2. DO NOT THERMITE WELD TO PVC PIPE.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/29/16

Chief Engineer

STANDARD DETAIL
PVC AWWA C-900 PIPE
4-INCH TO 12-INCH
ANODE PROTECTION FOR
RESTRAIN JOINT

C
7.10