


NOTES:

1. METER TO BE SET HORIZONTALLY.
2. BENDS IN REMOTE READER CONDUIT NO GREATER THAN 45° EXCEPT PER FITTING (EXCEPTION FOR 90° SWEEP FITTING)
3. SECURE METER HORN ABOVE AND BELOW TO PREVENT STRAIN ON PIPING.
4. LOCATE EXIT POINT FOR REMOTE READING DEVICE 1-1/2' TO 4' ABOVE FINISHED GRADE ON SAME WALL AS ELECTRIC METER. IF ELECTRIC METER IS LOCATED AT REAR OF BUILDING, LOCATE EXIT POINT IN FRONT OF BUILDING. REMOTE READER AND CABLE TO BE SUPPLIED BY WSSC.
5. PIPE BETWEEN UPSTREAM AND DOWNSTREAM SHUTOFF BALL VALVES SHALL BE COPPER.
6. A FULL-FLOW BUILDING WATER SERVICE VALVE SHALL BE INSTALLED WITHIN 3- FEET OF WHERE THE WATER SERVICE ENTERS THE BUILDING.

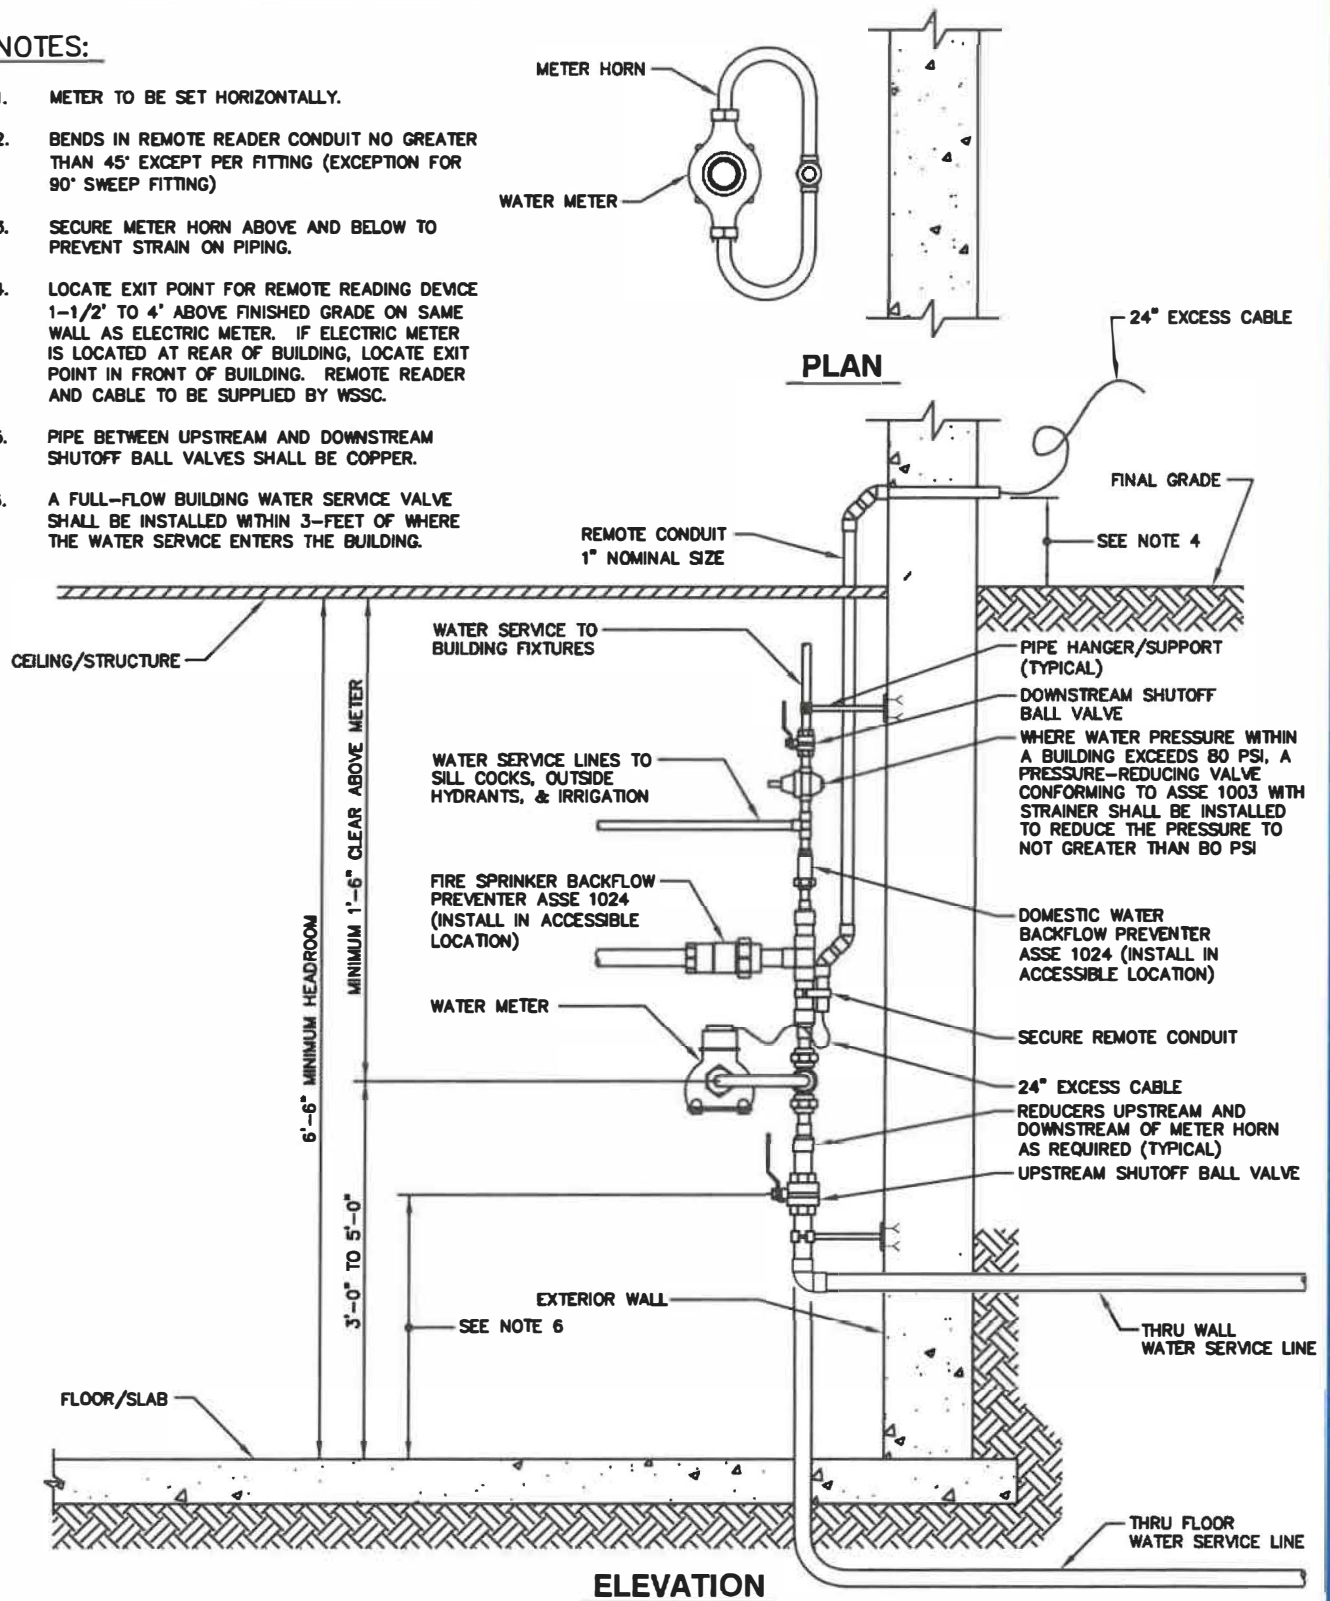

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 10/26/21

Nike Hammer
Chief Engineer

STANDARD DETAIL

1-INCH AND SMALLER
INSIDE WATER METER SETTING

W
7.1