


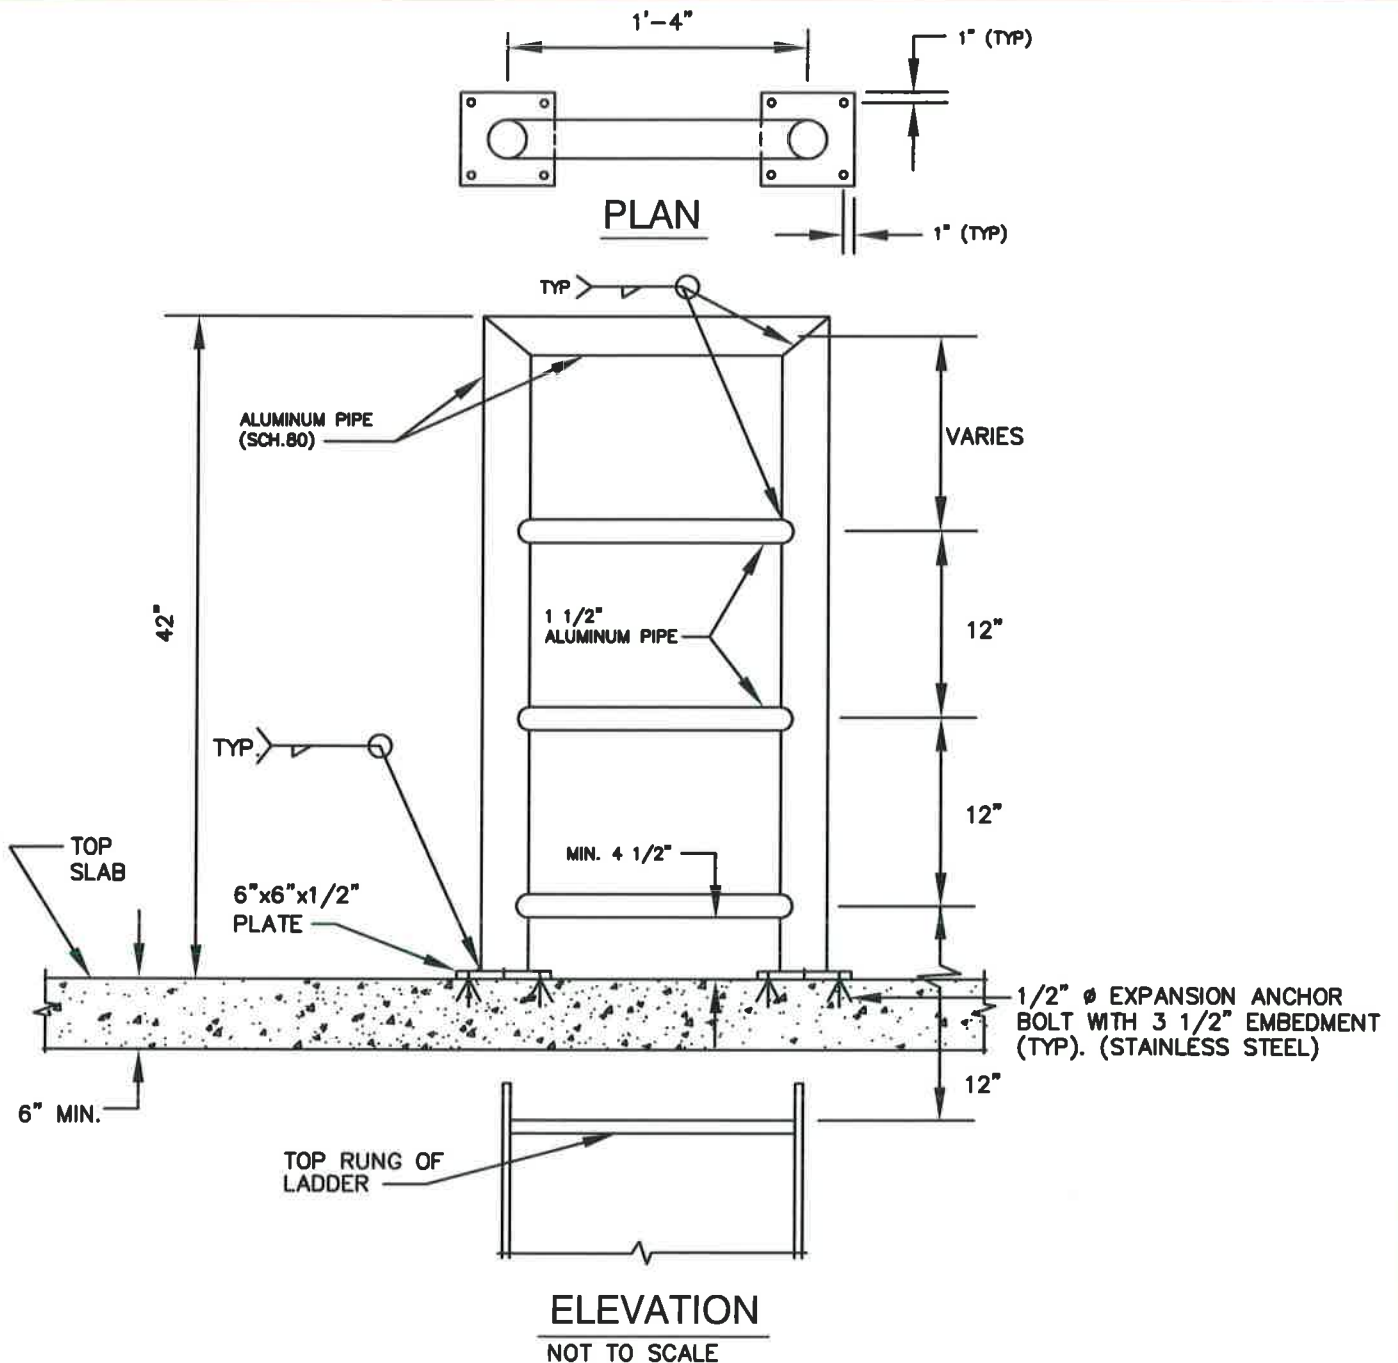

NOTES:

1. ALL ALUMINUM SHALL BE 6061 T-6 MATERIAL.
2. WELD SHALL BE 1/4" WIDE.
3. BITUMINOUS COAT ALUMINUM SURFACE IN CONTACT WITH CONCRETE.
4. GRAB BAR IS LOCATED 6" FROM EDGE OF OPENING UNLESS OTHERWISE NOTED.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 8/18/16

Chief Engineer

STANDARD DETAIL

ALUMINUM
GRAB BAR

M
15.0