
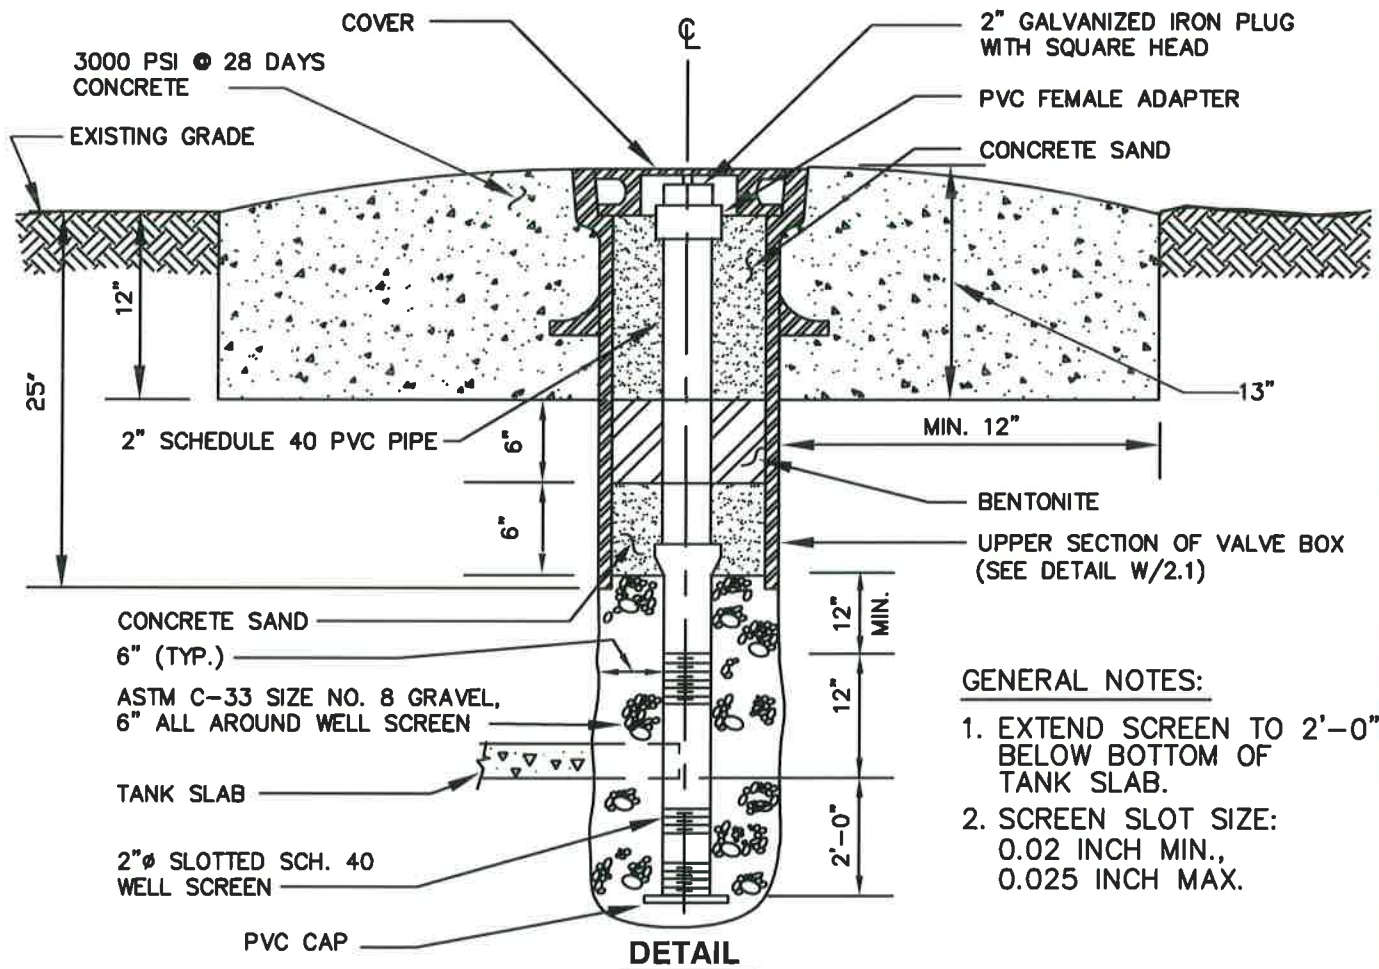


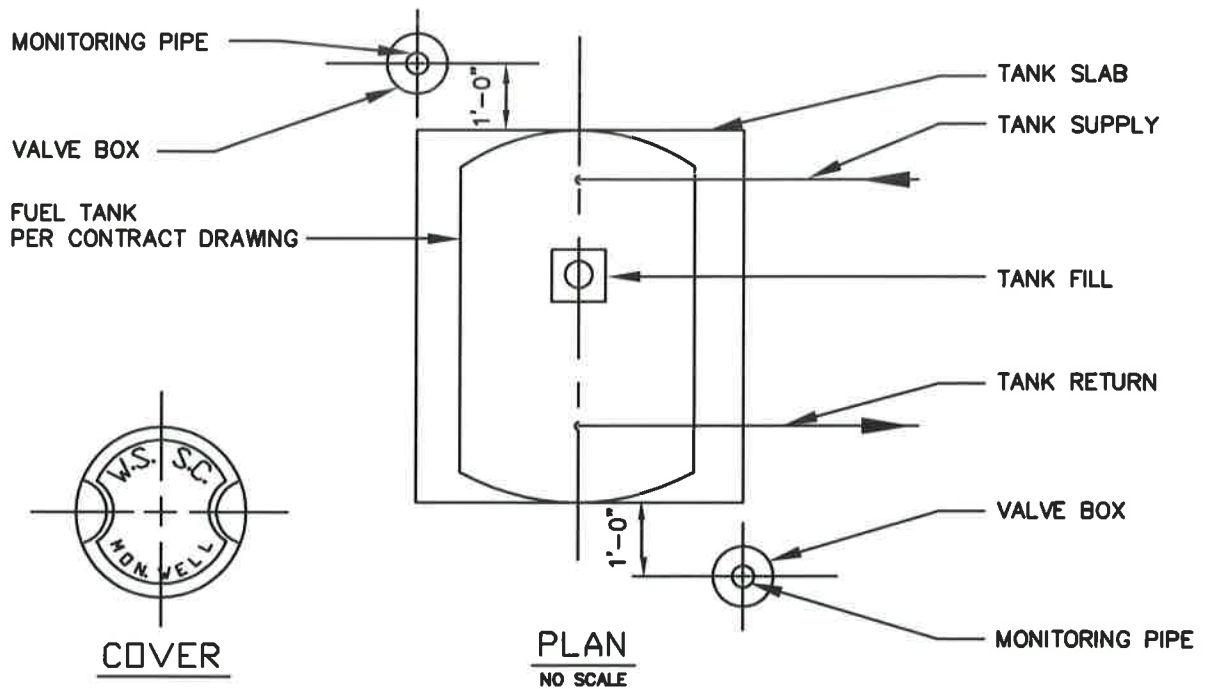

GENERAL NOTES:

1. EXTEND SCREEN TO 2'-0" BELOW BOTTOM OF TANK SLAB.
2. SCREEN SLOT SIZE: 0.02 INCH MIN., 0.025 INCH MAX.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 8/18/16

Chief Engineer

STANDARD DETAIL
MONITORING PIPE
OF FUEL TANK

M
20.0