
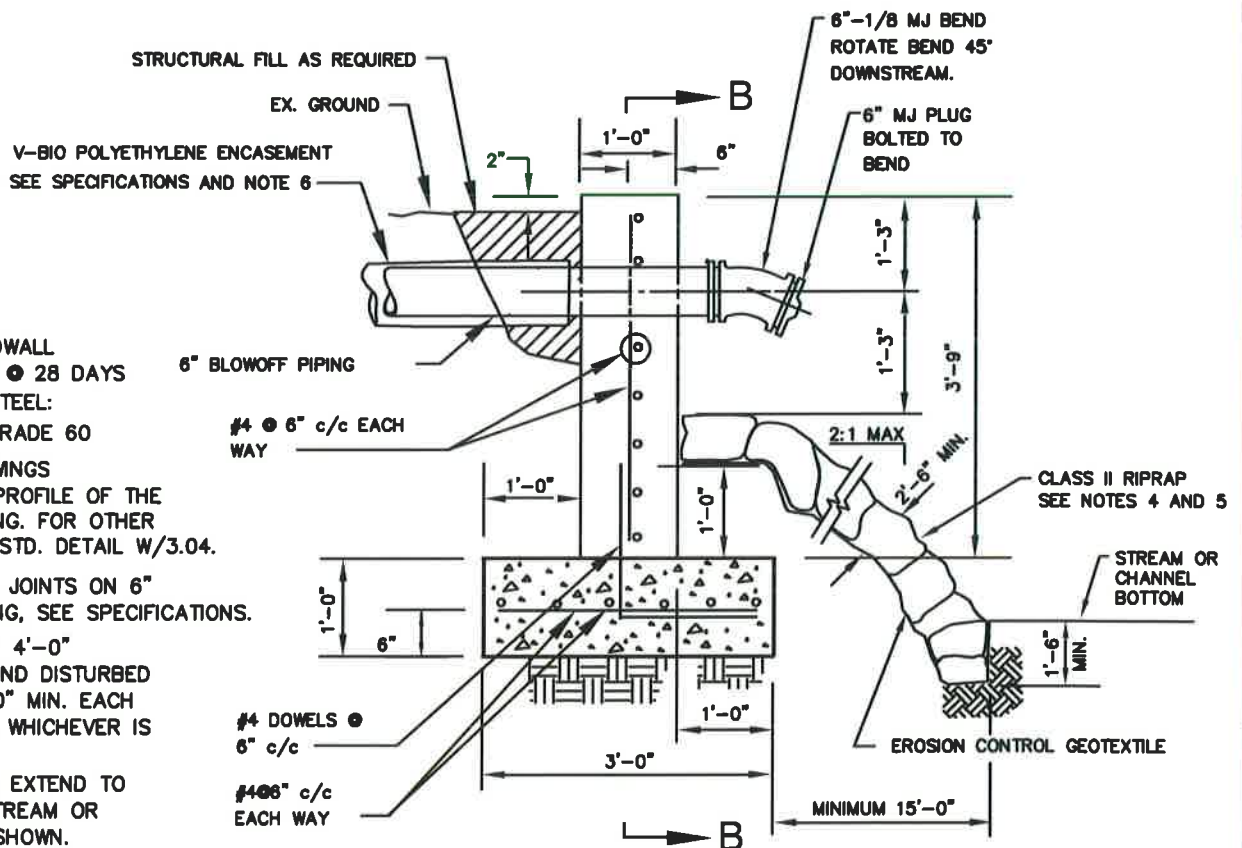


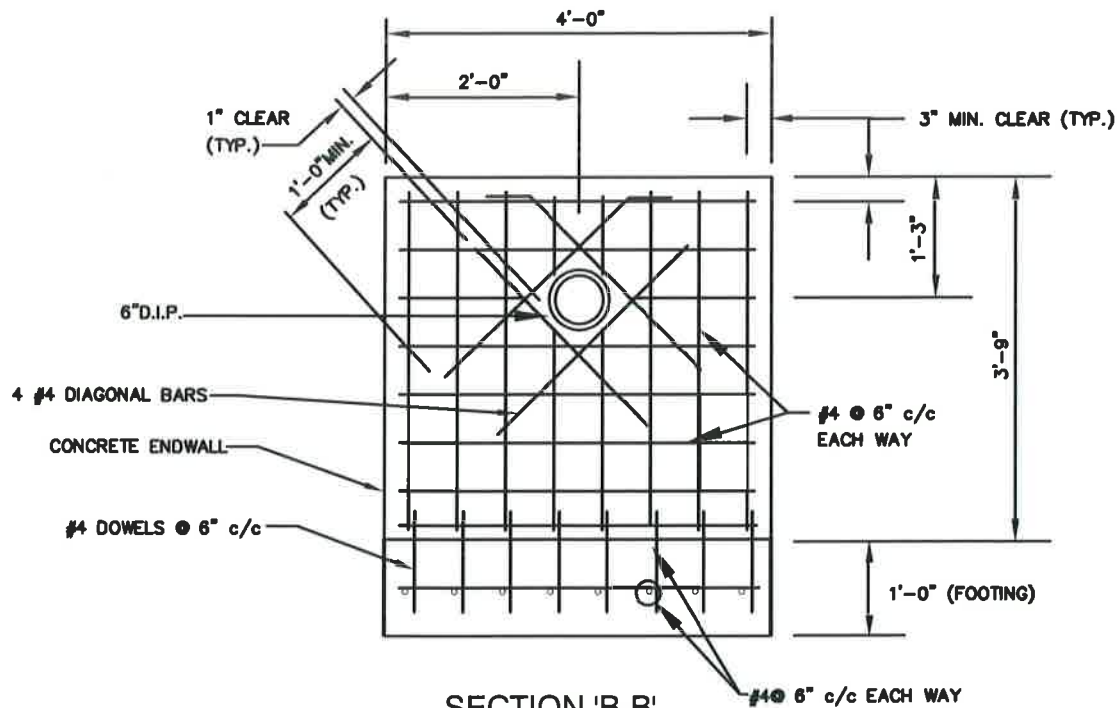

NOTES:

1. CONCRETE ENDWALL
F'c 4,000 PSI @ 28 DAYS
REINFORCED STEEL:
ASTM A615, GRADE 60
2. SEE THE DRAWINGS
FOR ACTUAL PROFILE OF THE
BLOWOFF PIPING. FOR OTHER
DETAILS, SEE STD. DETAIL W/3.04.
3. RESTRAIN ALL JOINTS ON 6"
BLOWOFF PIPING, SEE SPECIFICATIONS.
4. PLACE RIPRAP 4'-0"
MINIMUM BEYOND DISTURBED
AREA OR 6'-0" MIN. EACH
SIDE OF PIPE, WHICHEVER IS
GREATER.
5. RIPRAP SHALL EXTEND TO
BOTTOM OF STREAM OR
CHANNEL AS SHOWN.
6. SEE DETAIL W/2.8 FOR
V-BIO POLYETHYLENE ENCASMENT
AT END WALL INTERFACE.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:

9/28/16

Chief Engineer

STANDARD DETAIL

ENDWALL FOR TYPE "B"
BLOWOFF

W
3.01