


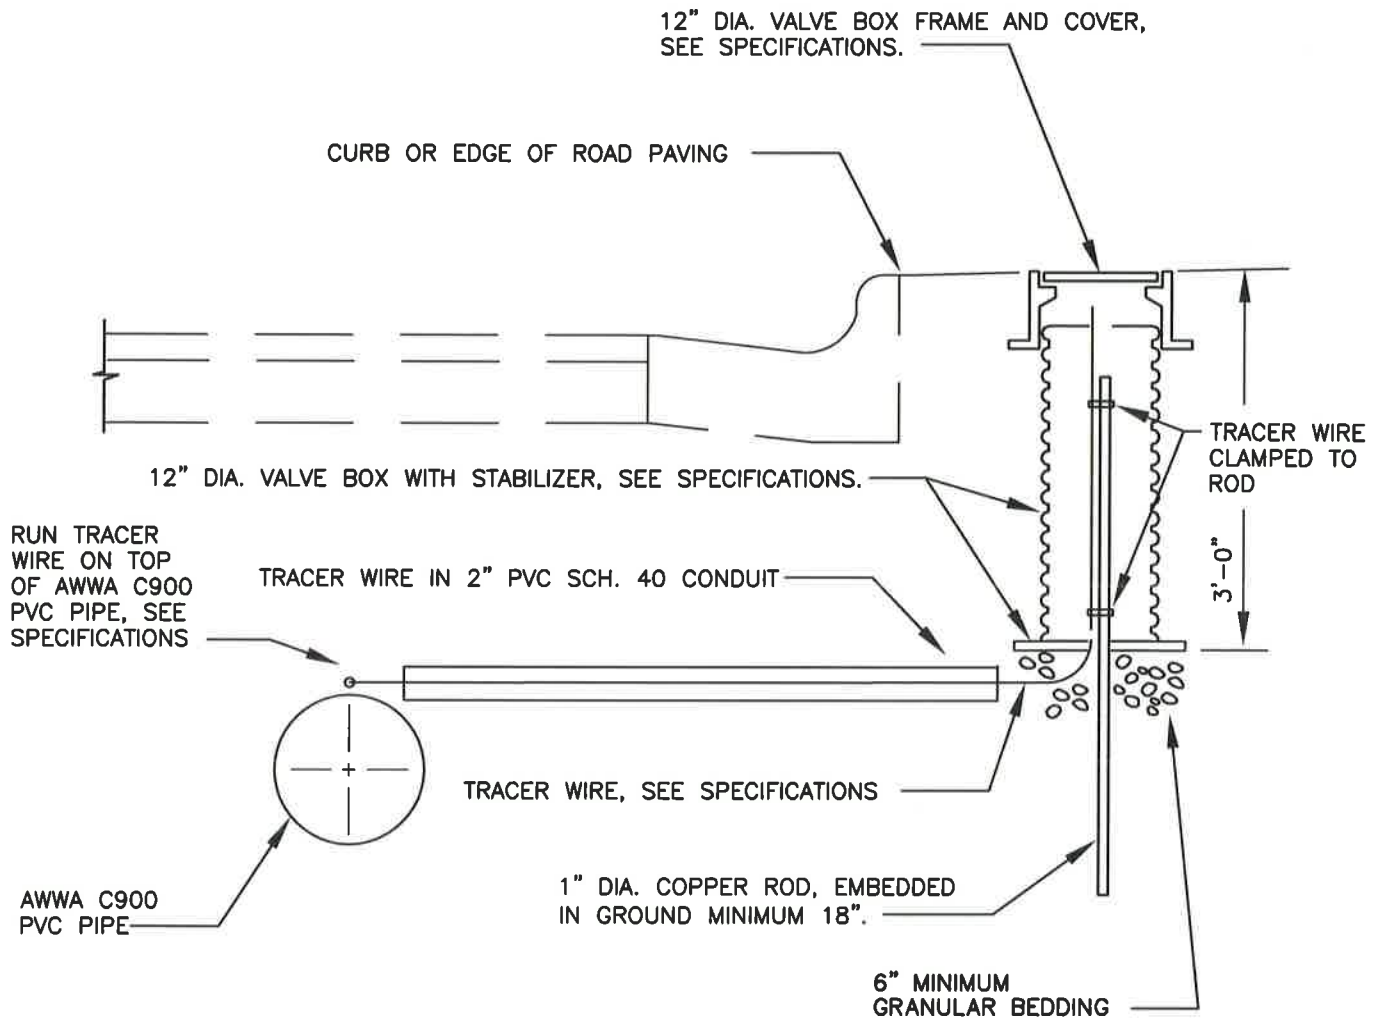

NOTE:

1. INSTALL TRACER WIRE IN 2" PVC SCH. 40 PVC WHEN NOT INSTALLED ON TOP OF PIPELINE.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 9/28/16

[Signature]
Chief Engineer

STANDARD DETAIL

CONTINUITY TEST STATION
FOR AWWA C900 PVC PIPE

W
9.0