


PLAN - 36" AND LARGER MAINS

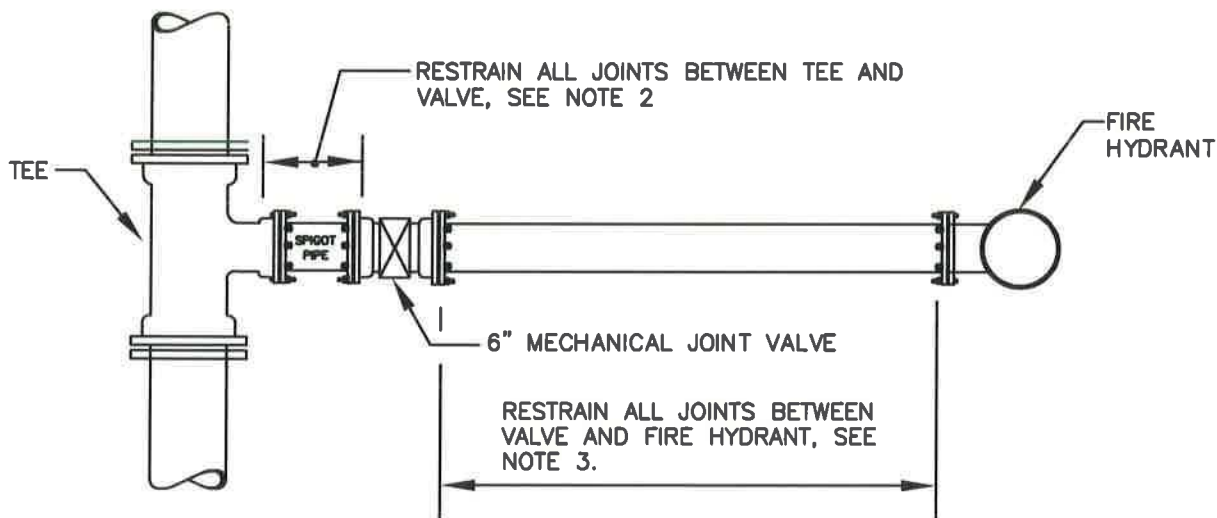


PLAN - 14" TO 30" MAINS

NOTES:

1. DO NOT BLOCK FIRE HYDRANT TEE OR FIRE HYDRANT.
2. RESTRAIN ALL JOINTS BETWEEN FIRE HYDRANT TEE AND VALVE, SEE DETAIL B/2.0
3. RESTRAIN ALL JOINTS FROM VALVE TO FIRE HYDRANT, USING WEDGE ACTION RESTRAINING GLANDS OR RESTRAINED JOINT GASKETS, SEE SPECIFICATIONS.
4. FOR WATER MAINS 36-INCH AND LARGER, USE TWO 6-INCH VALVES.
5. PLACE RESTRAINED JOINT PIPE TAPE ON TOP OF PIPE FROM FIRE HYDRANT TEE TO FIRE HYDRANT, SEE SPECIFICATIONS.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 8/18/16


Chief Engineer

STANDARD DETAIL
METHOD OF RESTRAINING
FIRE HYDRANT TO MAIN
14-INCH AND LARGER

B
2.2