


FILLER PUTTY
(TRENTON FILL-PUTTY
OR APPROVED EQUAL)

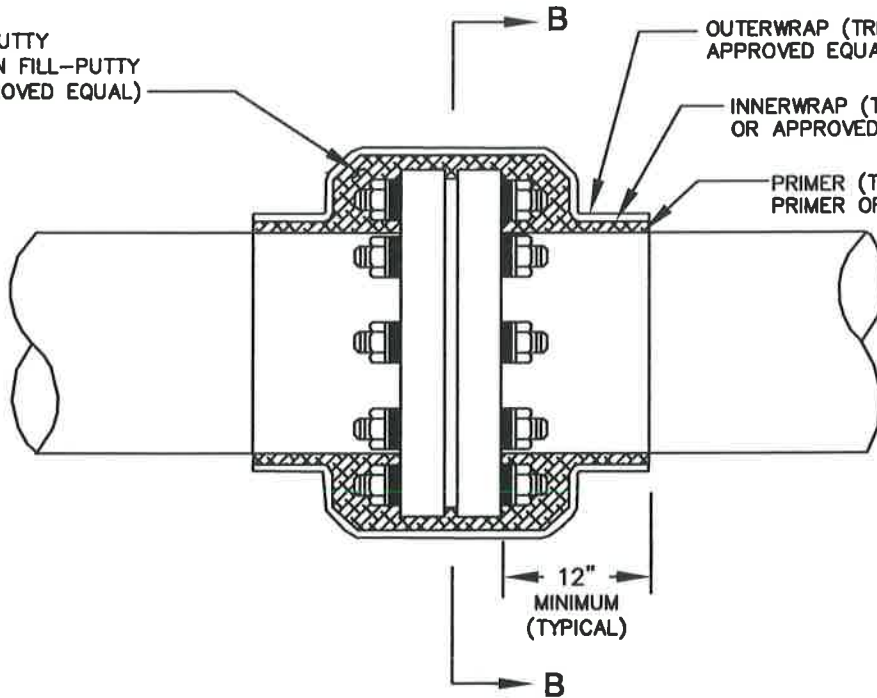

OUTERWRAP (TRENTON GLASS-WRAP OR
APPROVED EQUAL)


INNERWRAP (TRENTON #1 WAX TAPE
OR APPROVED EQUAL)

PRIMER (TRENTON WAX-TAPE
PRIMER OR APPROVED EQUAL)

12"
MINIMUM
(TYPICAL)

SIDE VIEW

FILLER PUTTY (TRENTON
FILL-PUTTY OR
APPROVED EQUAL)

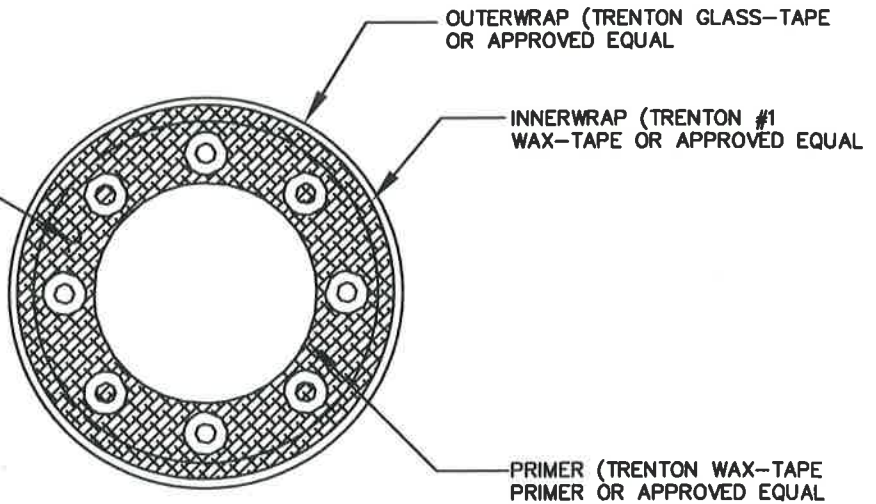

OUTERWRAP (TRENTON GLASS-TAPE
OR APPROVED EQUAL)

INNERWRAP (TRENTON #1
WAX-TAPE OR APPROVED EQUAL)


PRIMER (TRENTON WAX-TAPE
PRIMER OR APPROVED EQUAL)

SECTION VIEW "B-B"

NOTE:

SEE SPECIFICATIONS FOR THE PUTTY, OUTER AND INNER WRAP.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 8/12/16

Chief Engineer

STANDARD DETAIL

COATING OF INSULATING
FLANGE DETAIL

C
3.0a