



CONCRETE TEST STATION PAD, SEE DETAIL C/4.0.

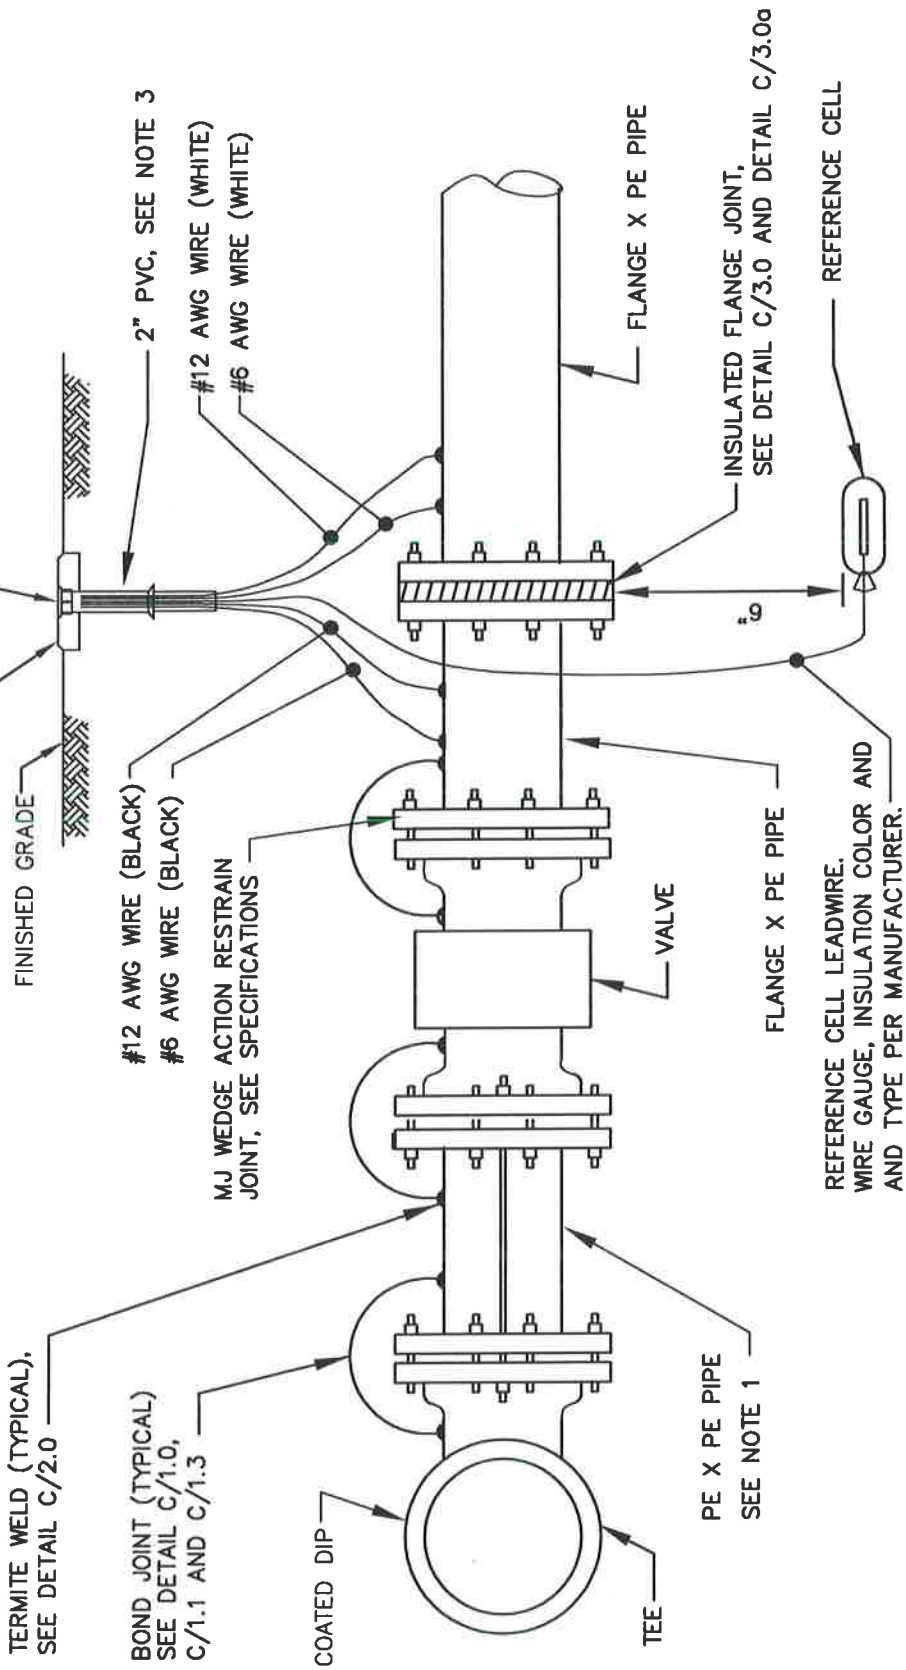

NOTES:

1. SEE DETAIL B/2.0 FOR DETAILS ON STRAPPING JOINTS.
2. FOR TEST LEAD WIRE REQUIREMENTS, SEE DETAIL C/3.0 AND NOTE 1.
3. RUN ALL WIRES IN 2" PVC SCH 40 CONDUIT FROM CONNECTION POINT UNTIL THEY REACH THE BOTTOM OF TEST STATION ASSEMBLY.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: 8/12/16

Chief Engineer

STANDARD DETAIL
VALVE TO MAIN
INSULATED FLANGE
JOINT (RESTRAINED)

C
3.1