COVER



COVER, PER SPECIFICATIONS

TERMINAL BLOCK



NOTES:

1. WHEN THE TEST STATION IS NOT DIRECTLY OVER THE PIPELINE, USE DETECTABLE WARNING TAPE 12" ABOVE THE LEAD WIRES.
2. LOCATE TEST STATION OUTSIDE OF PROPOSED OR EXISTING PAVED AREAS OR SIDEWALKS. (2' BACK IF POSSIBLE).
3. SEE DETAIL C/4.0a FOR WIRE TERMINATIONS.

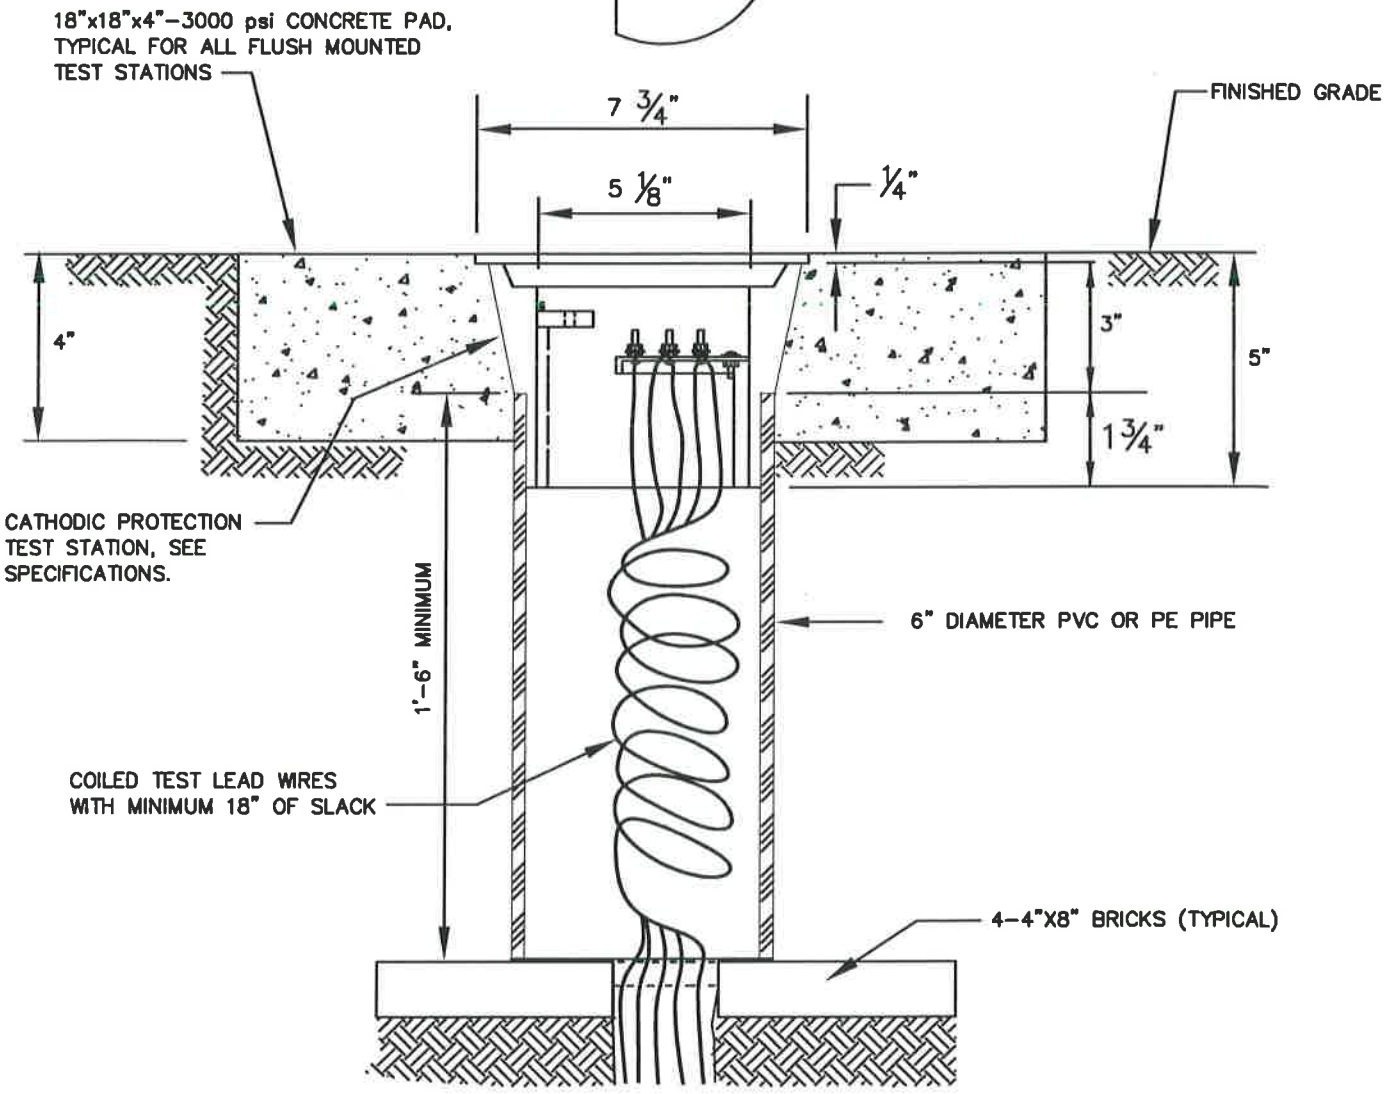

SECTION

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: 8/12/16 Chief Engineer	STANDARD DETAIL FLUSH - MOUNTED TEST STATION	C / 4.0