



CONCRETE TEST STATION PAD, SEE WSSC STANDARD DETAIL C/4.0.

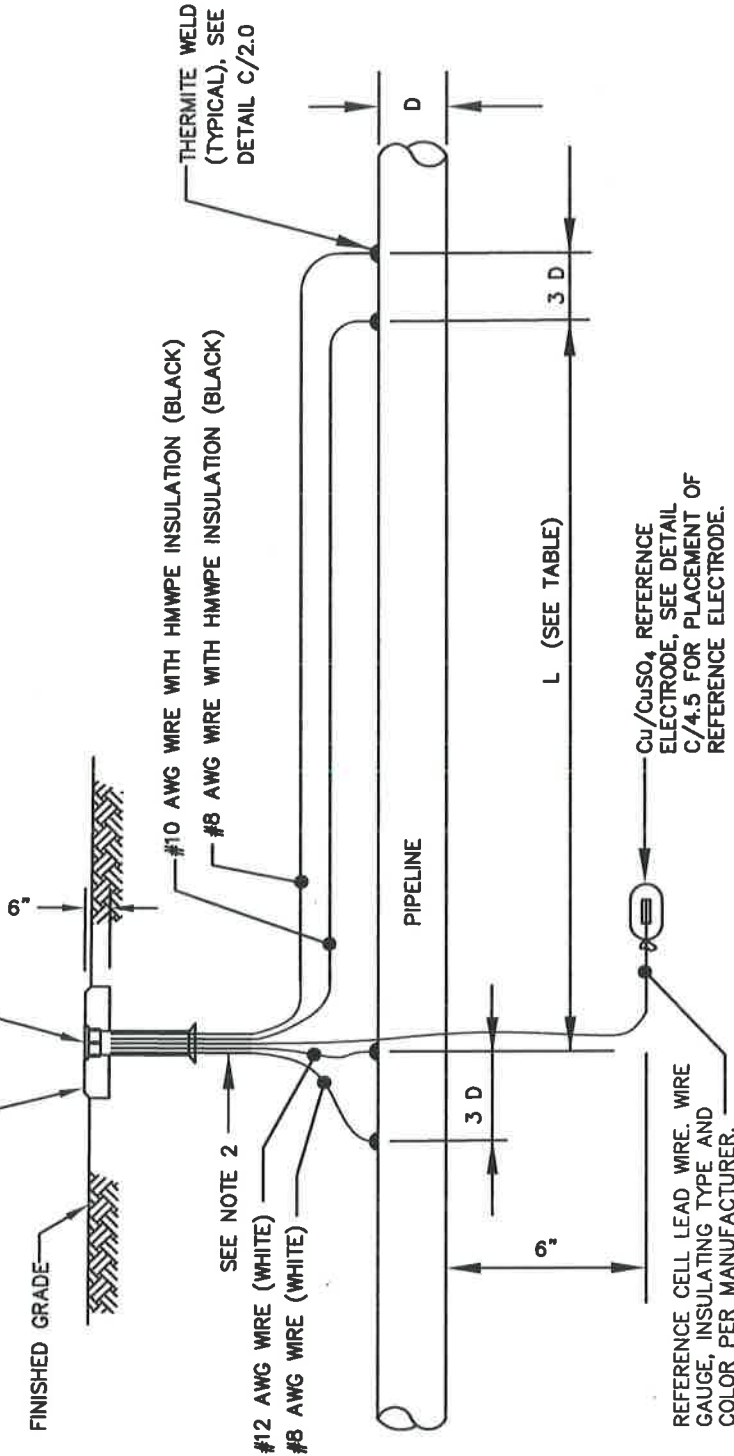

PIPE DIAMETER (D)	L (FEET)
4" TO 18"	100
20"	120
24"	160
30" TO 36"	200
42" TO 48"	240
54" TO 60"	300

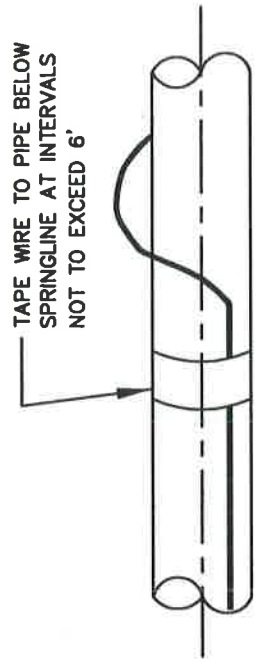

NOTE:
 1. EXCEPT AS SPECIFIED ABOVE, TEST LEAD WIRES SHALL MEET REQUIREMENTS OF DETAIL C/3.0.
 2. RUN ALL WIRES IN 2" PVC SCH40 CONDUIT FROM CONNECTION POINTS UNTIL THEY REACH THE BOTTOM OF TEST STATION ASSEMBLY.

WASHINGTON
 SUBURBAN
 SANITARY
 COMMISSION

APPROVED: 8/12/16

 Chief Engineer

STANDARD DETAIL
 IR DROP TEST
 STATION FOR
 DUCTILE IRON PIPE

C
 4.6