


CONNECT ANODE TO VALVE WITH BOLTED CONNECTION, SEE DETAIL C/1.2

4", 6", 8", OR 10" PVC PIPE

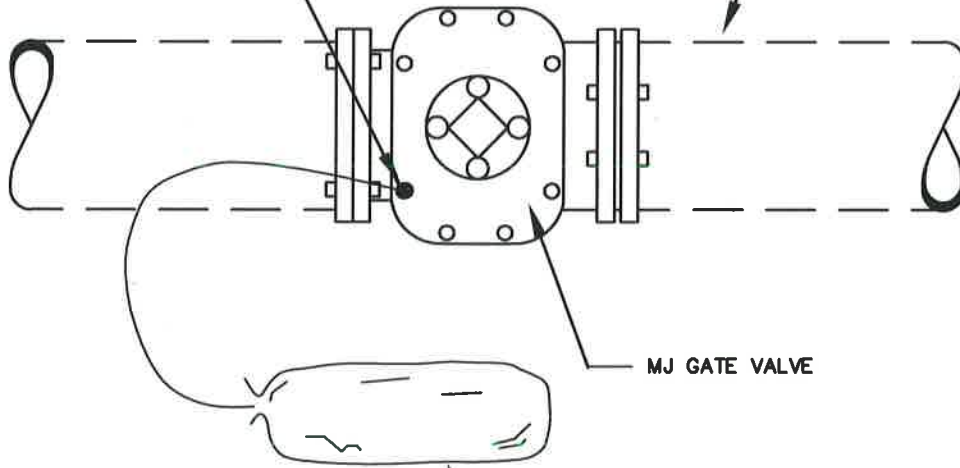

MJ GATE VALVE

INSTALL ONE 17 POUND PREPACKAGED MAGNESIUM ANODE.

NOTES:

1. ANODE PLACED AT SAME DEPTH AS THE BOTTOM OF PIPE AND AT A MINIMUM OF 12" FROM EDGE OF PIPE, SEE DETAIL C/7.12.
2. DO NOT THERMITE WELD TO PVC PIPE.

WASHINGTON  
SUBURBAN  
SANITARY  
COMMISSION

APPROVED:

9/29/16

Chief Engineer

STANDARD DETAIL

PVC AWWA C-900 PIPE  
4-INCH, 6-INCH, 8-INCH, OR 10-INCH  
ANODE PROTECTION VALVE

C  
7.0