


PLAN


NOTE: SIZE OF SIDE WALL SADDLE SHALL HAVE MIN. 1 1/2" I.P.S. OUTLET.

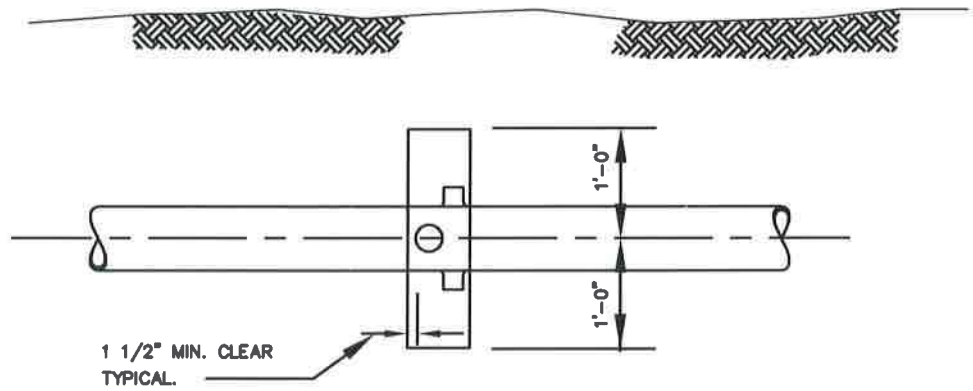

SECTION A-A

NOTES:

1. $f'c = 3000 \text{ PSI} @ 28 \text{ DAYS.}$
2. CARRY ALL BEARING SURFACE TO UNDISTURBED GROUND OR FIRM SUBGRADE.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: <u>8/19/16</u>  Chief Engineer	STANDARD DETAIL PRESSURE SEWER BLOCKING DETAIL FOR H.D.P.E. PIPE.	PS <hr style="width: 50%; margin: 0 auto;"/> 3.0
--	---	--	---