

REMOVE MANHOLE FRAME AND  
COVER AND RETURN TO  
COMMISSION WAREHOUSE.


EXISTING FINISHED GRADE

REMOVE MANHOLE TO 1'-0"  
MINIMUM BELOW FINISH GRADE.

FILL MANHOLE SOLID W/LEAN  
MIX CONCRETE OR FLOWABLE  
FILL.

FILL ENTIRE LENGTH BETWEEN  
MANHOLES WITH FLOWABLE FILL.  
SEE NOTE 1.

FILL ENTIRE LENGTH BETWEEN  
MANHOLES WITH FLOWABLE FILL.  
SEE NOTE 1.

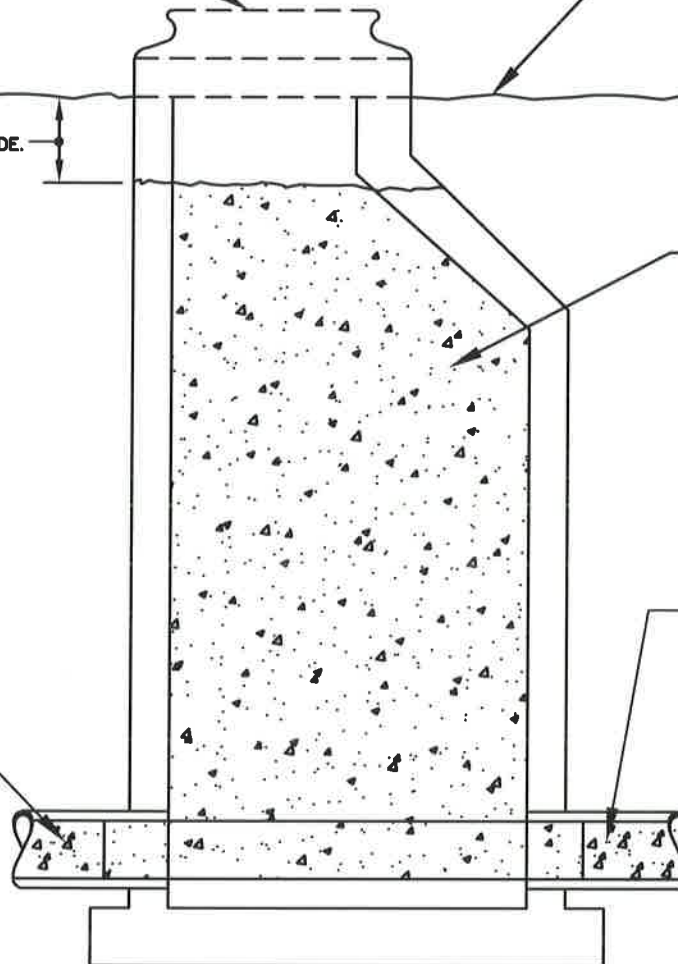

NOTE:

1. IF EXISTING SEWER IS REMOVE FROM MANHOLE TO MANHOLE, SEE DETAIL S/3.5

WASHINGTON  
SUBURBAN  
SANITARY  
COMMISSION

APPROVED:

*9/24/10*  
*[Signature]*

Chief Engineer

STANDARD DETAIL

MANHOLE AND SEWER  
ABANDONMENT

S  
3.6