


PLAN

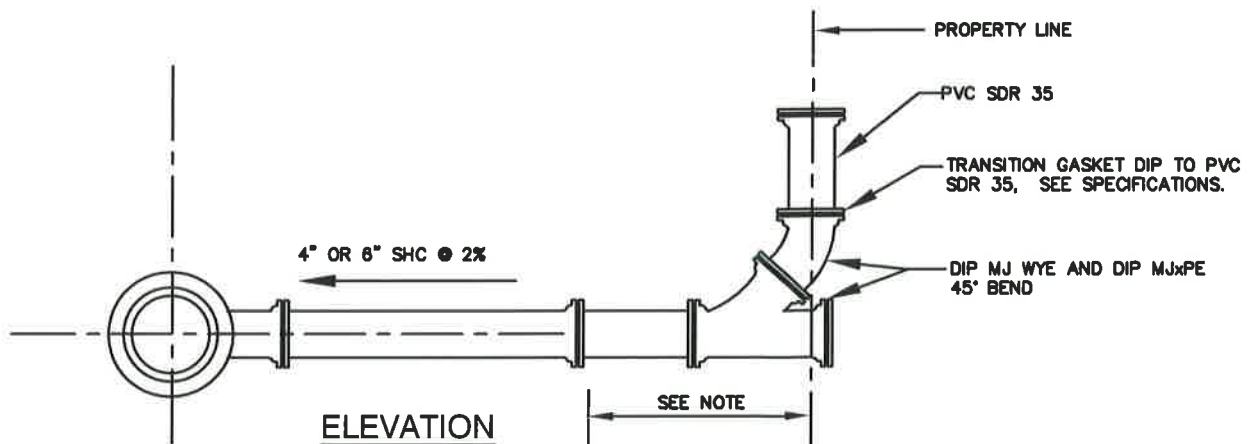

ELEVATION

NOTES:

1. SHC AT PROPERTY SHALL TERMINATE IN ACCORDANCE WITH DETAIL S/6.8.
2. CONCRETE ENCASEMENT NOT REQUIRED FOR DUCTILE IRON WYE ON BEND. SEE NOTE AND DETAIL S/6.8
3. SEE CONNECTION TO SEWER MAIN NOTES, DETAIL S/6.0.
4. ORIENT T-WYE AS SHOWN WITH RESPECT TO FLOW.
5. ALL DIP SHALL BE MIN. CL.54
6. ALL DIP SHALL HAVE SPECIAL INTERIOR COATING, SEE SPECIFICATIONS.

WASHINGTON  
SUBURBAN  
SANITARY  
COMMISSION

APPROVED:

9/29/16

Chief Engineer

STANDARD DETAIL  
4-INCH AND 6-INCH  
DIP OR PVC AWWA C900  
HOUSE CONNECTIONS  
AND FITTINGS

S  
6.3a