


NOTE:

1. NOTES (1) THRU (9) ON DETAIL S/1.0 APPLY TO THIS DETAIL.

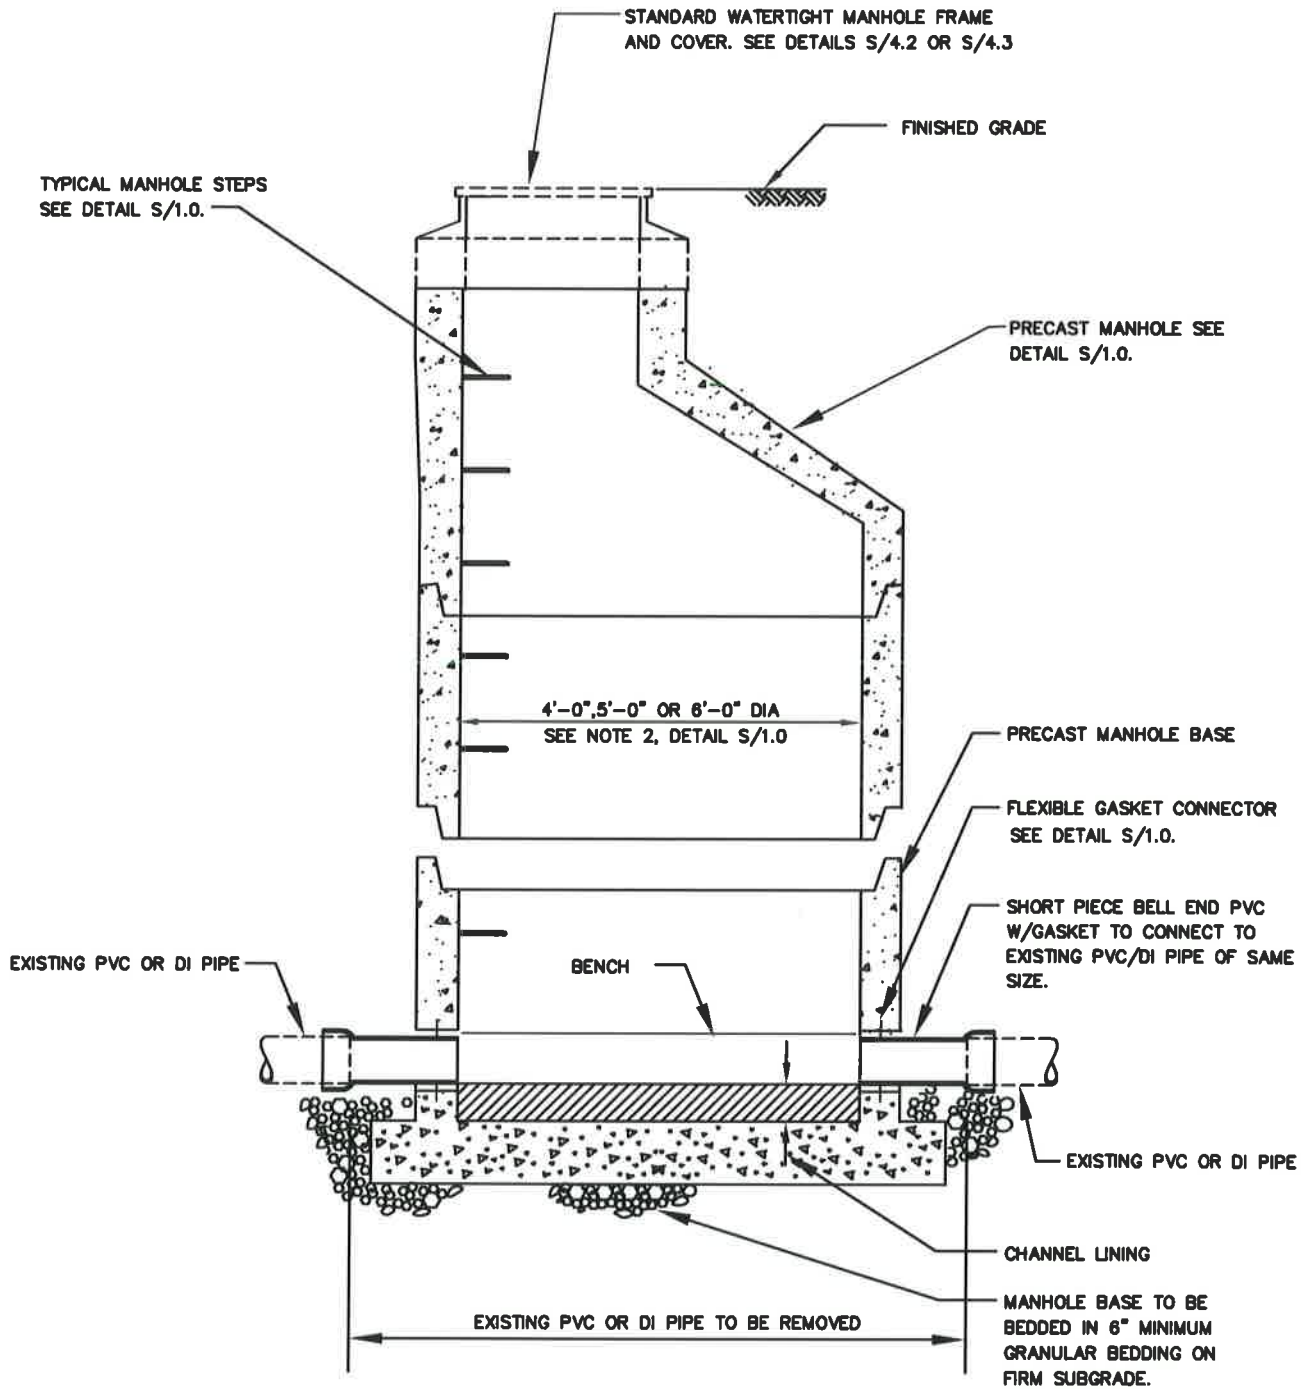

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:

9/21/16

Chief Engineer

STANDARD DETAIL

PRECAST MANHOLE
BUILT ON EXISTING
PVC OR DI PIPE

S
2.2