


# NOTE FOR PIPE CONNECTION TO BRICK MANHOLE

1. DO NOT PROVIDE FLEXIBLE GASKET CONNECTORS.
2. USE ONLY DUCTILE IRON PIPE WITH SPECIAL INTERIOR LINING, SEE SPECIFICATIONS, REINFORCED CONCRETE PIPE OR AWWA C900/905 PVC. FOR REQUIREMENTS OF AWWA C900/905 PVC SEE SPECIFICATIONS.

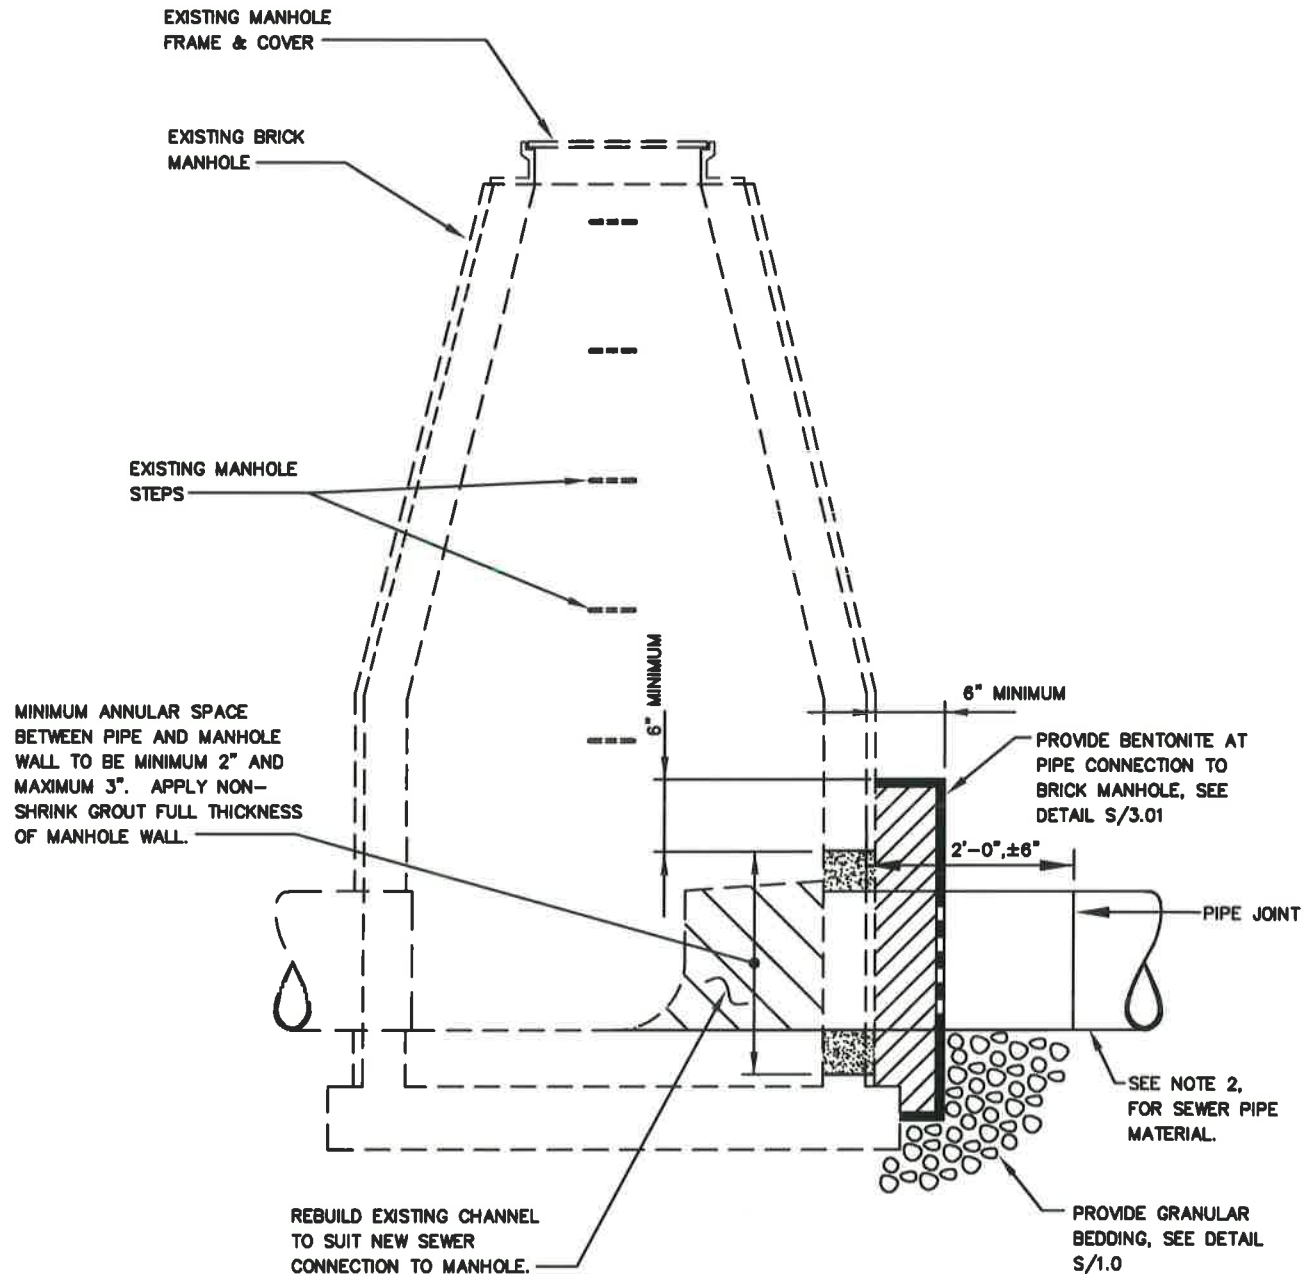

WASHINGTON  
SUBURBAN  
SANITARY  
COMMISSION

APPROVED:

9/29/16  
*[Signature]*  
Chief Engineer

STANDARD DETAIL  
PIPE TO EXISTING BRICK  
MANHOLE CONNECTION FOR  
USING DIP, RCP OR  
AWWA C900/905 PVC ONLY

S  
3.0