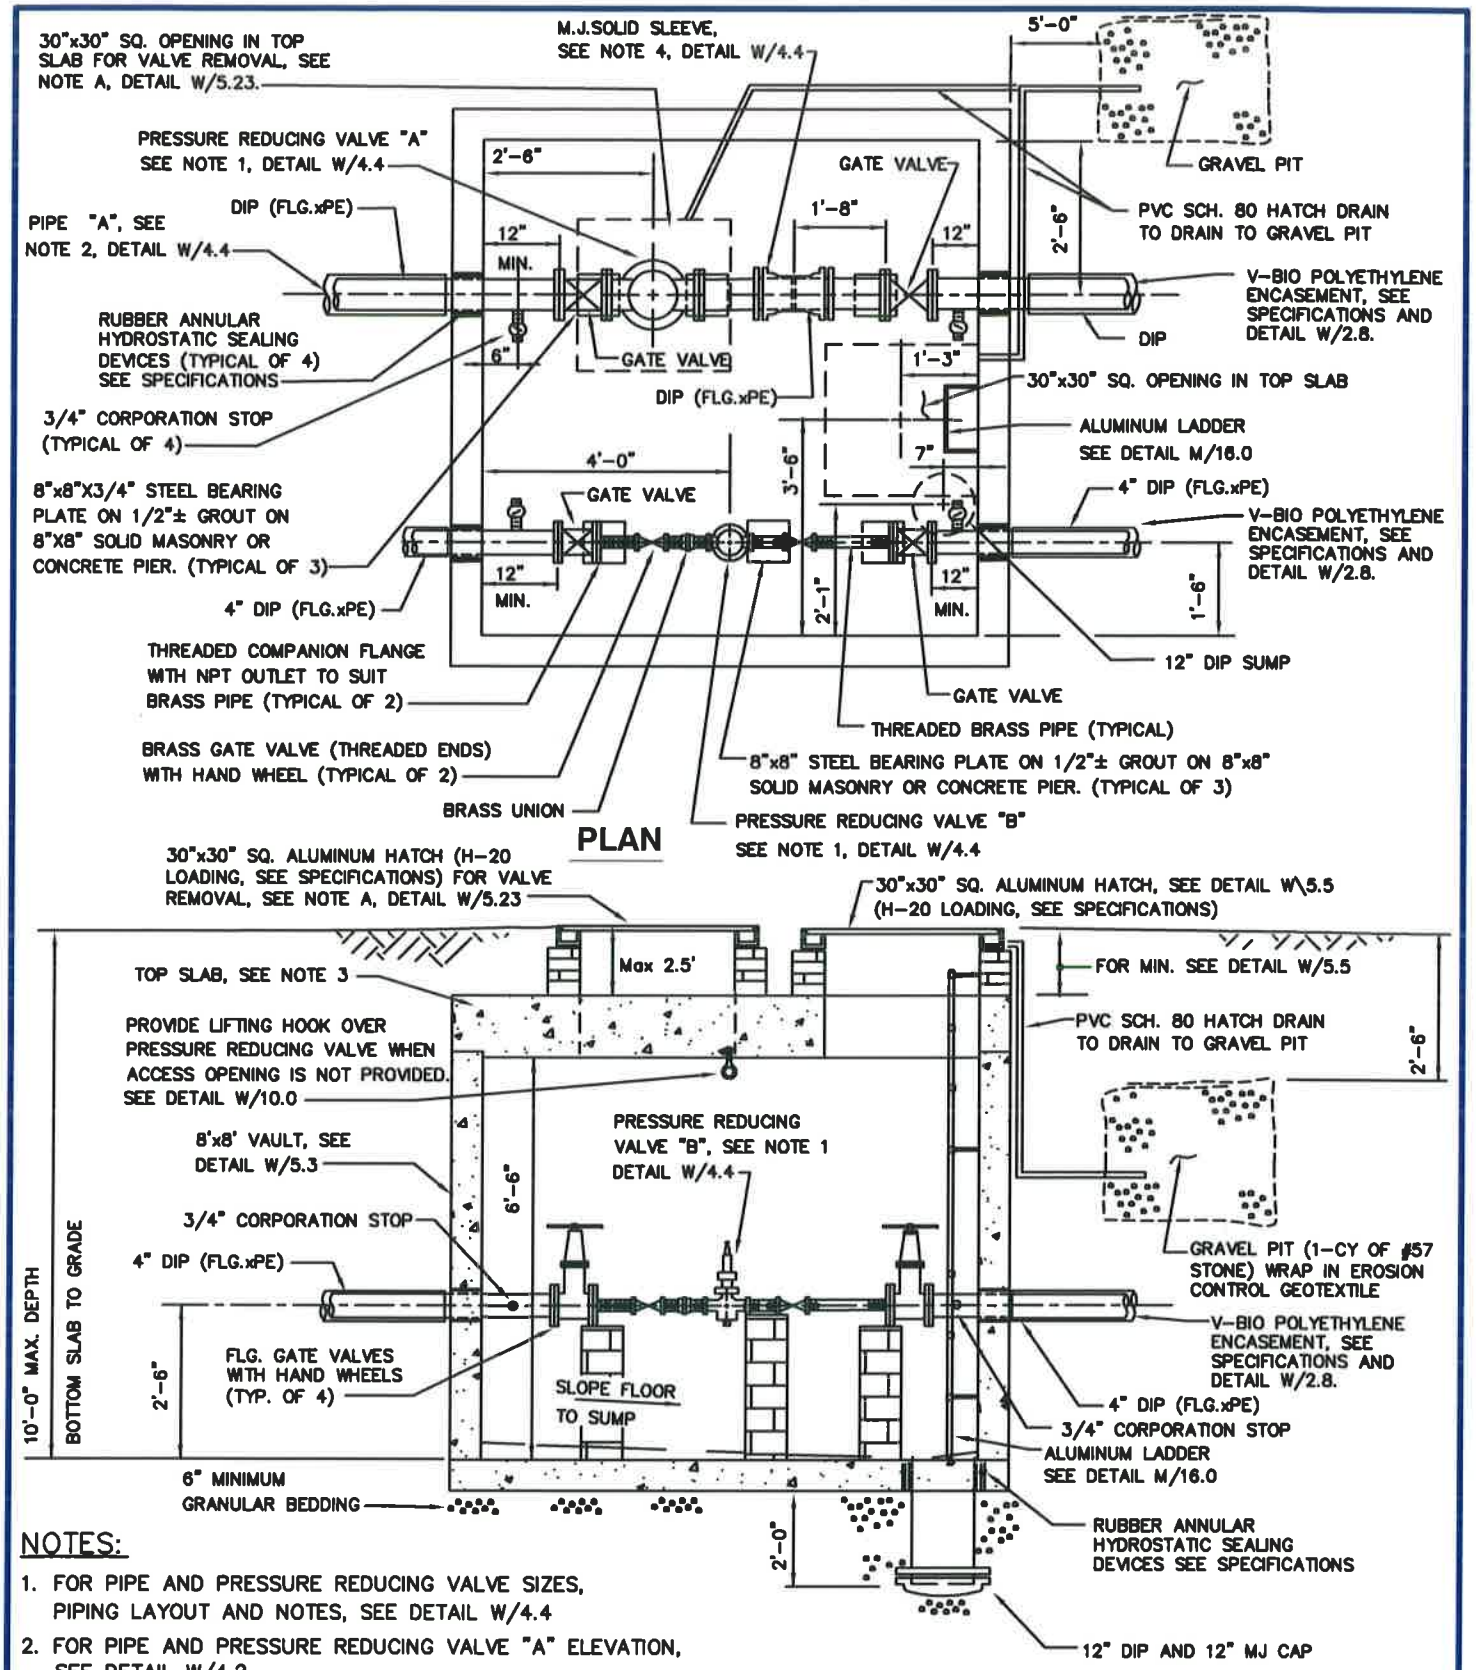

NOTES:

1. FOR PIPE AND PRESSURE REDUCING VALVE SIZES, PIPING LAYOUT AND NOTES, SEE DETAIL W/4.4
2. FOR PIPE AND PRESSURE REDUCING VALVE "A" ELEVATION, SEE DETAIL W/4.2
3. FOR TOP SLAB DETAIL, SEE DETAIL W/5.23.

WASHINGTON SUBURBAN SANITARY COMMISSION	APPROVED: 9/28/16 Chief Engineer	STANDARD DETAIL PRESSURE REDUCING VALVE VAULT TYPE "2" LAYOUT	W / 4.3