




INSULATED JOINT,
SEE DETAIL C/3.5.

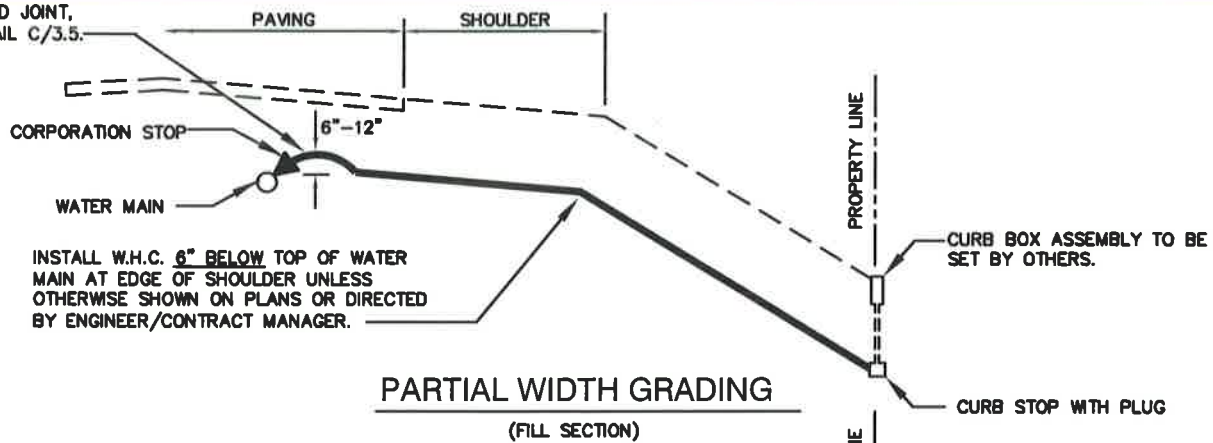

INSULATED JOINT,
SEE DETAIL C/3.5.

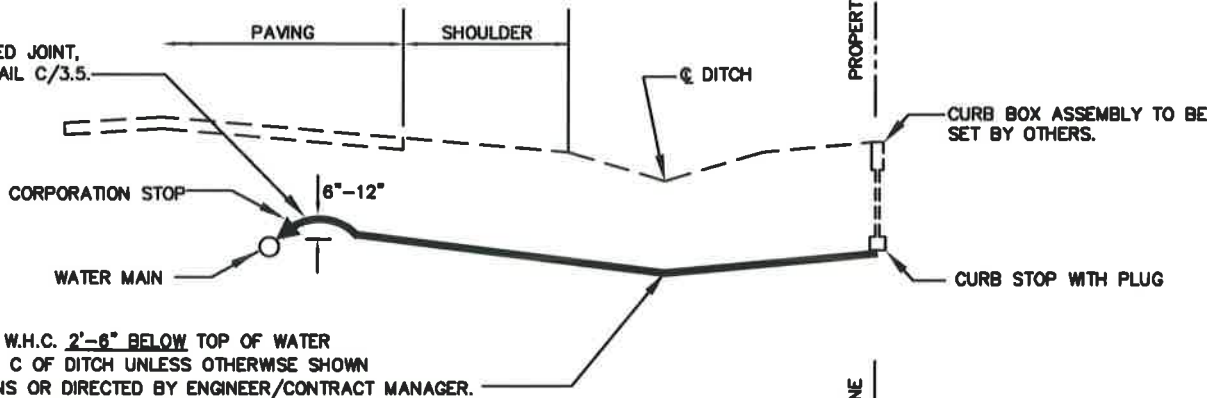

INSULATED JOINT,
SEE DETAIL C/3.5.

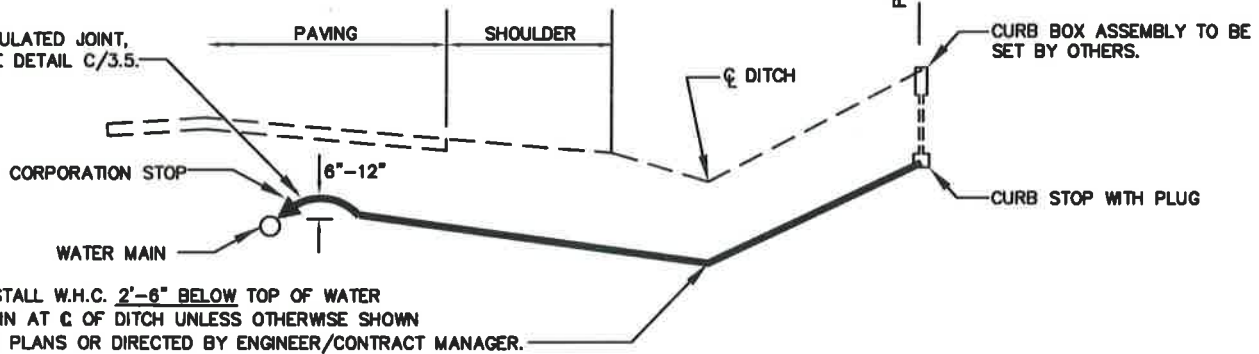

NOTES:

1. INSTALL W.H.C. 3'-6" MINIMUM BELOW FINISHED GRADE, UNLESS OTHERWISE SHOWN OR DIRECTED BY THE ENGINEER.
2. WHEN W.H.C. AND S.H.C. ARE INSTALLED IN SAME TRENCH, SEE DETAIL M/18.0.
3. END OF W.H.C. AT THE PROPERTY LINE. PROVIDE 4'-0" COVER OVER END ON W.H.C., UNLESS OTHER DIRECTED BY THE ENGINEER/CONTRACT MANAGER.
4. CORPORATION STOP TO BE LEFT OPEN AND CURB STOP TO STAY CLOSED.
5. AN APPROVED BENDING TOOL REQUIRED FOR MAKING BENDS IN ALL SIZES OF TYPE "K" COPPER PIPE.
6. FOR CONNECTIONS TO NEW WATER PIPE, V-BIO POLYETHYLENE ENCASEMENT IS REQUIRED ON NEW COPPER PIPE, SEE SPECIFICATIONS.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED:

9/28/16

Chief Engineer

STANDARD DETAIL
1-INCH, 1-1/2-INCH AND 2-INCH
WATER HOUSE CONNECTIONS
FOR INSIDE METERS RURAL
TYPE PAVING SECTION

W
5.11