


NOTES:

1. METER TO BE SET HORIZONTALLY.
2. BENDS IN REMOTE READER CONDUIT NO GREATER THAN 45° EXCEPT 90° PERMITTED AT EXIT.
3. SECURE METER RACK ABOVE AND BELOW TO PREVENT STRAIN ON PIPING.
4. LOCATE EXIT POINT FOR REMOTE READING DEVICE 2-1/2' TO 4' ABOVE FINISHED GRADE ON SAME WALL AS ELECTRIC METER. IF ELECTRIC METER IS LOCATED AT REAR OF BUILDING, LOCATE EXIT POINT IN FRONT OF BUILDING. REMOTE READER AND CABLE TO BE SUPPLIED BY WSSC.

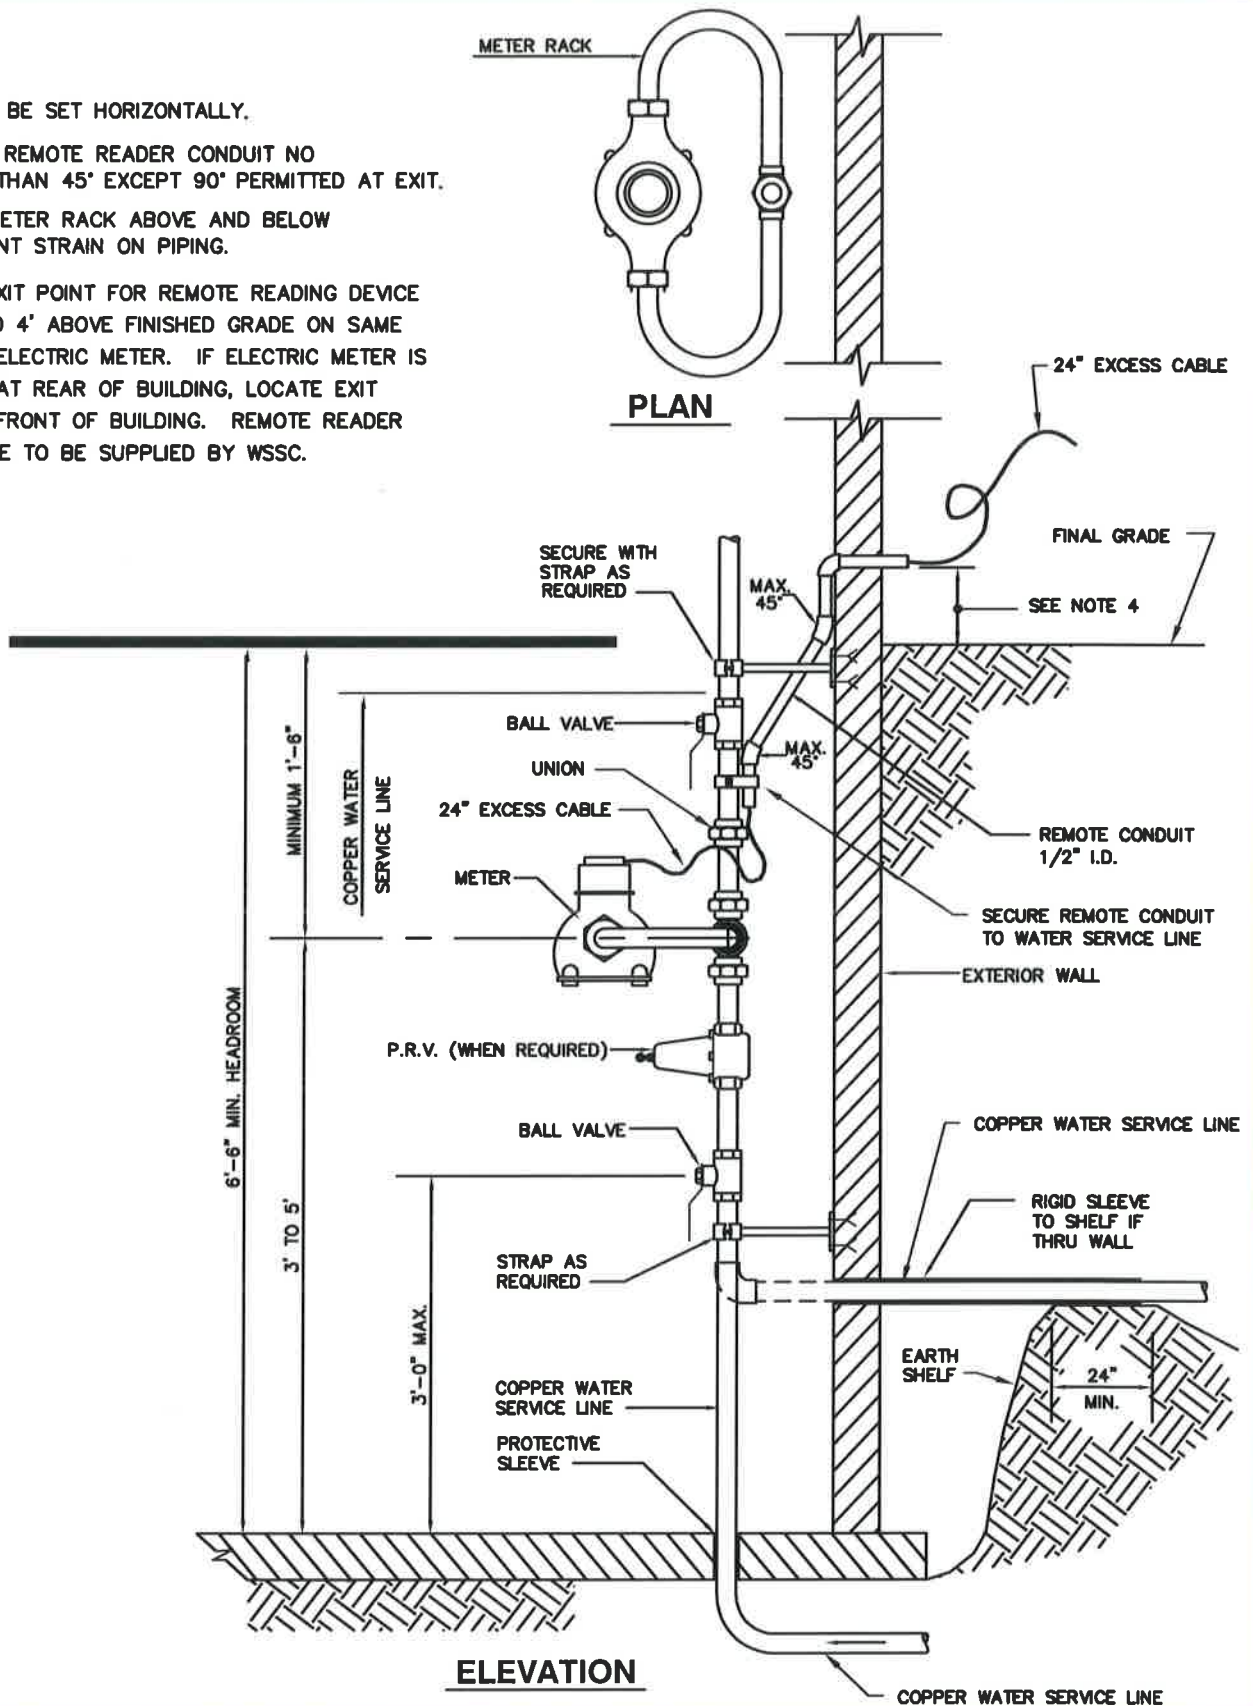

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: _____

9/28/16

Chief Engineer

STANDARD DETAIL

1-INCH AND SMALLER
INSIDE WATER METER SETTING

W
7.1