


TYPE OF HYDRANT	H (IN.)	
	MIN.	MAX.
U.S. PIPE AND FOUNDRY CO.	18	24
MUELLER COMPANY	18	24
KENNEDY VALVE	17 1/4	23 1/4
AMERICAN FLOW CONTROL	14	20

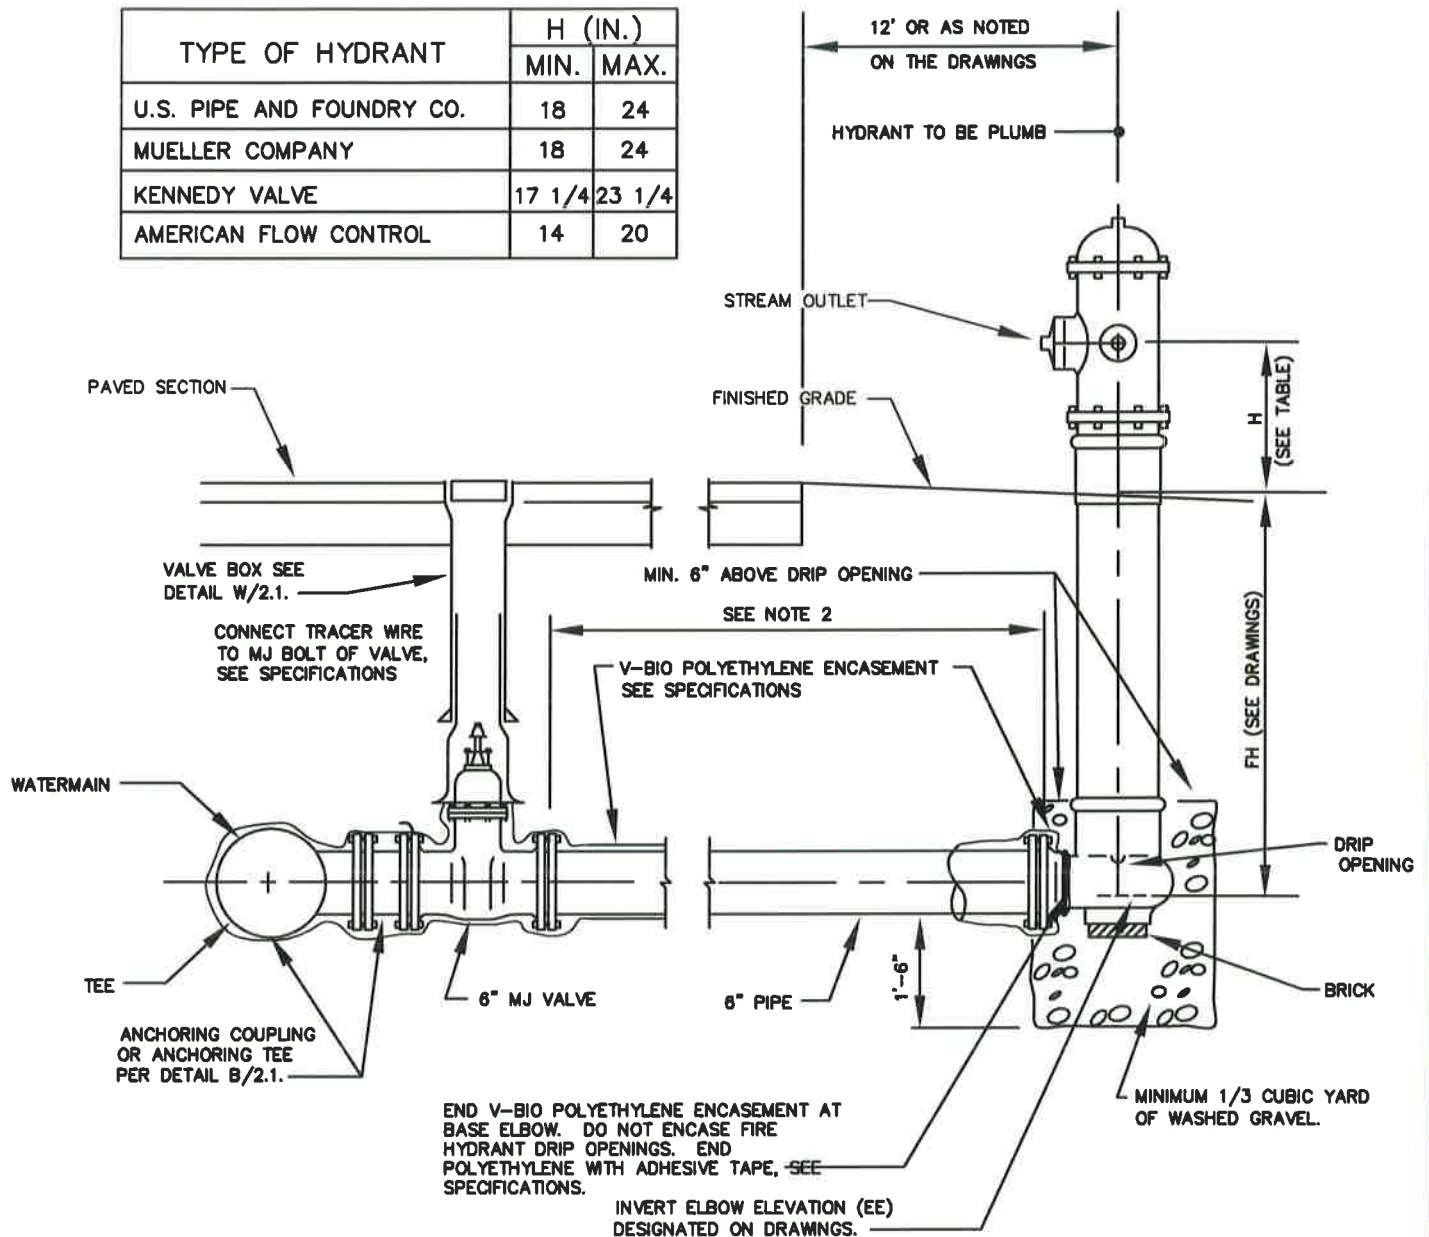

NOTES:

1. DO NOT BLOCK FIRE HYDRANT OR FIRE HYDRANT TEE.
2. FOR RESTRAINING VALVE TO FIRE HYDRANT, SEE DETAIL B/2.1.

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

APPROVED: _____

7/28/16

Chief Engineer

STANDARD DETAIL

FIRE HYDRANT SETTING
OPEN PAVING SECTION

W
8.1