



**SECTION A-A
(DOUBLE COVER)**

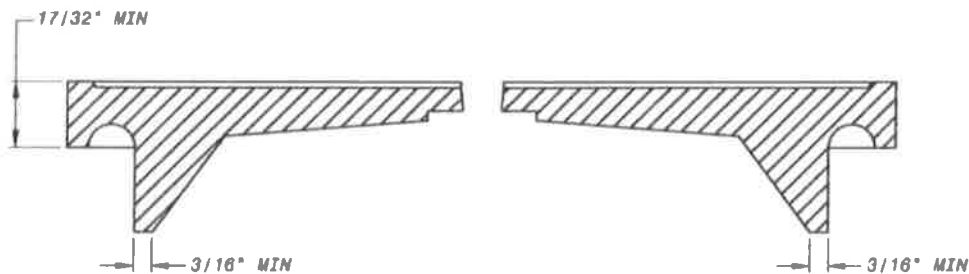

**SECTION B-B
(TYP SINGLE COVER AND DOUBLE COVER)**

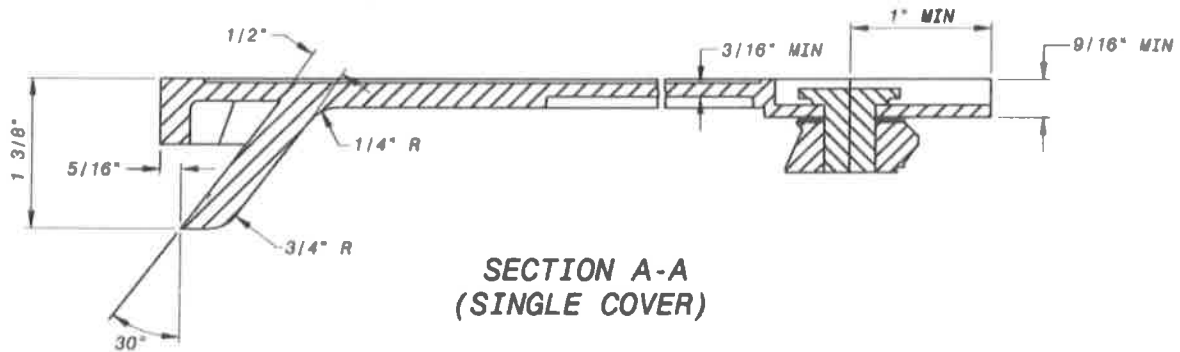

**SECTION A-A
(SINGLE COVER)**

NOTES:

1. ALL GRAY IRON CASTINGS TO BE ASTM A48 CLASS 25 MIN.
2. SEE P&M/4.1 FOR FURTHER DETAILS
3. TOLERANCE OF $\pm 1/16$ " UNLESS NOTED OTHERWISE
4. CASTING SHALL BE CLEANED BY AN APPROVED PROCESS AND COATED WITH AN APPROVED ASPHALTIC OR COAL TAR COATING

WASHINGTON
SUBURBAN
SANITARY
COMMISSION

REVISIONS:

APPROVED: *[Signature]*
10/28/14
MATERIAL AND SERVICES GROUP LEADER

PROCUREMENT AND MANUFACTURING DETAIL

**SINGLE AND DOUBLE
METER COVERS**

**P&M
4.2**